

香港電燈有限公司
The Hongkong Electric Co., Ltd.



**Lamma Power Station
Units L2, L4 & L5 Flue Gas Desulphurization
Plants Retrofit
Operational Phase**

Quarterly Environmental Monitoring & Audit Report

July – September 2024

香港電燈有限公司
The Hongkong Electric Co., Ltd.



ENVIRONMENTAL IMPACT ASSESSMENT (EIA) ORDINANCE, CAP. 499

ENVIRONMENTAL PERMITS NO. EP-248/2006 & EP-287/2007

**LAMMA POWER STATION
UNITS L2, L4 & L5 FLUE GAS DESULPHURIZATION PLANTS RETROFIT**

**ENVIRONMENTAL MONITORING & AUDIT PROGRAMME
AT OPERATIONAL PHASE**

Report Title Quarterly EM&A Report
(July to September 2024)

Date 23 December 2024

Certified by 

(Mr. CHAN Hon Yeung, Environmental Team
Leader)

TABLE OF CONTENT

EXECUTIVE SUMMARY

1.	INTRODUCTION.....	1
1.1	Background	1
1.2	Project Organisation	1
1.3	Plant Availability during the Reporting Period	2
1.4	Malfunction/Outage Records of Pollution Control Equipment	2
1.5	Summary of EM&A Requirements	2
2.	AIR QUALITY	10
2.1	Monitoring Requirements	10
2.2	Summary of Results and Observations	10
3.	WATER QUALITY	11
3.1	Monitoring Requirements	11
3.2	Summary of Results and Observations	11
4.	ENVIRONMENTAL AUDIT	12
4.1	Review of Environmental Monitoring Procedures	12
4.2	Assessment of Environmental Monitoring Results	12
4.3	Status of Environmental Licensing and Permitting	13
4.4	Implementation Status of Environmental Mitigation Measures	14
4.5	Implementation Status of Event/Action Plan	14
4.6	Implementation Status of Environmental Complaint Handling Procedures	14
5.	FUTURE KEY ISSUES.....	16
5.1	Outage Plan for the coming 3 months	16
5.2	Key issues for the coming 3 months	16
6.	CONCLUSION	17

LIST OF TABLES

Table 2.1	Air Quality Monitoring Parameters and Frequency
Table 3.1	Water Quality Monitoring Parameters and Frequencies
Table 4.1	Summary of Action/Limit Level Exceedances on Monitoring Parameters
Table 4.2	Amount of Gypsum and Sludge Collected for Reuse by Contractor
Table 4.3	Summary of Environmental Licensing and Permit Status
Table 4.4	Environmental Complaints Received
Table 4.5	Outstanding Environmental Complaints Carried Over

LIST OF FIGURES

- Figure 1.1a Location of New Facilities for L4 & L5 FGD Plant
- Figure 1.1b Location of New Facilities for L2 FGD Plant
- Figure 1.2a General Arrangement of L4 & L5 FGD Plant
- Figure 1.2b General Arrangement of L2 FGD Plant
- Figure 1.3 Schematic Diagram of L2, L4 & L5 FGD Plant
- Figure 1.4 Simplified Schematic Diagram of FGD Wastewater Treatment Plant
- Figure 1.5 Organization Chart at Operational Phase

APPENDIX

- Appendix A Event/Action Plans in Response to Exceedance of AL Levels
- Appendix B Air Quality Monitoring Results
- Appendix C Summary Results on Water Quality Monitoring
- Appendix D Summary of EMIS

EXECUTIVE SUMMARY

This is the quarterly Environmental Monitoring and Audit (EM&A) report for the Projects “Lamma Power Station Units L4 & L5 Flue Gas Desulphurization Plant Retrofit” and “Lamma Power Station Unit L2 Flue Gas Desulphurization Plant Retrofit” prepared by the Environmental Team (ET). This report presents the results of impact monitoring on air and water quality and environmental audit for the operation of the said projects in the period from July to September 2024.

Environmental monitoring for air quality and water quality were carried out for the purpose of this EM&A program as well as for fulfilling the requirements stipulated in the relevant licences. The results were checked against the established Action/Limit (AL) levels. The implementation status of the environmental mitigation measures, Event/Action Plan and environmental complaint handling procedures were also checked.

Plant Availability

Unit L2 and Unit L4 were retired in October 2022 and January 2024 respectively. Unit L5 was retired in June 2024 and would be used for emergency generation if required.

Malfunction/Outage Records of Pollution Control Equipment

There were no major/minor outages of the Pollution Control Equipment during the reporting period.

Environmental Monitoring Works

Environmental monitoring works were performed during the operation of Units L2, L4 and L5 FGD Plants in the reporting period.

Air Quality

No exceedance of Action and Limit levels for air quality were recorded in the reporting period.

Water Quality

No exceedance of Action and Limit levels for water quality were recorded in the reporting period.

Environmental Licensing and Permitting

Description	Permit / Licence No.	Valid Period		Issued To	Date of Issuance
		From	To		
Environmental Permit for L4/5 FGD plants retrofit project	EP-248/2006	25/04/2006	-	HK Electric	25/04/2006
Environmental Permit for Unit L2 FGD plant retrofit project	EP-287/2007	02/10/2007	-	HK Electric	02/10/2007
Specified Process Licence issued under APCO	L-7-002(14)	01/01/2023	31/12/2024	HK Electric	30/12/2022
WPCO discharge licence for Ash Lagoon	WT00039618-2021	11/02/2022	31/12/2026	HK Electric	11/02/2022

Implementation Status of Environmental Mitigation Measures

Environmental mitigation measures were implemented in the reporting period.

Environmental Complaints / Feedback Cases

During the reporting period, there was one environmental feedback case regarding Lamma Power Station as summarized in Section 4.6. The reported issue was not related to the project and was satisfactorily addressed.

Future key issues

Key issues to be considered in the coming months include:

Air Impact

- To continuously carry out the air quality monitoring for Units L2, L4 and L5 (if emergency generation is required).

Water Impact

- To continuously carry out the water quality monitoring for FGD WWT plant.

Concluding Remarks

The environmental performance of the projects was generally satisfactory.

1. INTRODUCTION

The Environmental Team (hereinafter called the “ET”) was formed within The Hongkong Electric Co. Ltd (HK Electric) to undertake Environmental Monitoring and Audit for the “Operation of Lamma Power Station Units L4 & L5 Flue Gas Desulphurization Plant Retrofit Project” under the requirements of Clause 2.18 of Environmental Permit (EP) No. EP-248/2006 and “Operation of Lamma Power Station Unit L2 Flue Gas Desulphurization Plant Retrofit Project” under the requirements of Clause 2.10 of Environmental Permit (EP) No. EP-287/2007.

This report summarizes the environmental monitoring and audit work for the said Projects for the period from July to September 2024.

1.1 Background

The Projects involves retrofitting the three existing coal-fired generating Units L2, L4 and L5 of Lamma Power Station with Flue Gas Desulphurisation (FGD) plants for reducing sulphur dioxide emissions in support of Government policy to improve the air quality of the Pearl River Delta.

The Projects include the installation and operation of FGD plants with flue gas desulphurization efficiency of 90% for the three coal-fired Units L2, L4 & L5 to reduce the overall SO₂ emissions from Lamma Power Station. The process adopted for the FGD plants is “Wet Limestone-Gypsum”, a technology which has already been used in, and proved effective and reliable for the existing coal-fired units L6, L7 & L8. The flue gas from the boiler is directed to the FGD absorber inside which removal of SO₂ is take place by reaction with limestone slurry. After passing through the absorber, the treated flue gas is heated up by a gas-gas heater to over 80°C at boiler rated capacity and directed back to the existing chimney for discharge to the atmosphere. [Figure 1.1a](#), [Figure 1.1b](#), [Figure 1.2a](#), [Figure 1.2b](#) and [Figure 1.3](#) show the location and schematic of the FGD plants.

Wastewater filtrated from the reacted limestone slurry, i.e. gypsum slurry, is produced and it is directed to the existing FGD wastewater treatment plant (WWTP). The FGD WWTP is designed to treat the effluent from FGD plants by alkalization, precipitation and neutralization processes. The schematic diagram of the FGD WWTP is illustrated in [Figure 1.4](#).

The additional equipment for the FGD Plants retrofit projects for Units L2, L4 and L5 includes:

- Three sets of FGD absorbers and associated ductworks
- Three sets of booster fans
- Three sets of gas-gas heaters
- Two FGD Switchgear and Equipment Buildings
- Gypsum dewatering system comprising two sets of hydrocyclones and belt filters

1.2 Project Organisation

The management structure to oversee the Projects includes the following:

- Environmental Protection Department (The Authority);
- General Manager (Corporate Development) (The official contact person between HK Electric and EPD);
- Environmental Team Leader (ET Leader);

- Environmental Team (ET).

The organization chart for the Operation EM&A programme is shown in [Figure 1.5](#).

1.3 Plant Availability during the Reporting Period

Unit L2 and Unit L4 were retired in October 2022 and January 2024 respectively. Unit L5 was retired in June 2024 and would be used for emergency generation if required.

1.4 Malfunction/Outage Records of Pollution Control Equipment

There were no major/minor outages of the Pollution Control Equipment during the reporting period.

1.5 Summary of EM&A Requirements

Environmental Monitoring and Audit (EM&A) requirements have been discussed in the Environmental Impact Assessment (EIA) Report/ Project Profile for the Projects. The assessment results indicate that environmental monitoring works required for the EM&A programmes of these Projects are already in place or would be implemented under Lamma Power Station Extension Environmental Permit or environmental licenses for the operation of the existing Lamma Power Station. Such monitoring works are considered adequate for the Projects and no additional EM&A activities are required. Hence, environmental monitoring for air quality and water quality are carried out for the purpose of this EM&A program as well as for fulfilling the requirements stipulated in the relevant licences.

The EM&A monitoring work for air and water quality are described in [Section 2](#) and [Section 3](#) respectively.

The following environmental audits are summarized in [Section 4](#) of the report:

- Environmental monitoring results;
- The status of environmental licensing and permits for the Projects;
- The implementation status of environmental protection and pollution control / mitigation measures.

The future key issues for the Projects will be reported in [Section 5](#) of this report.

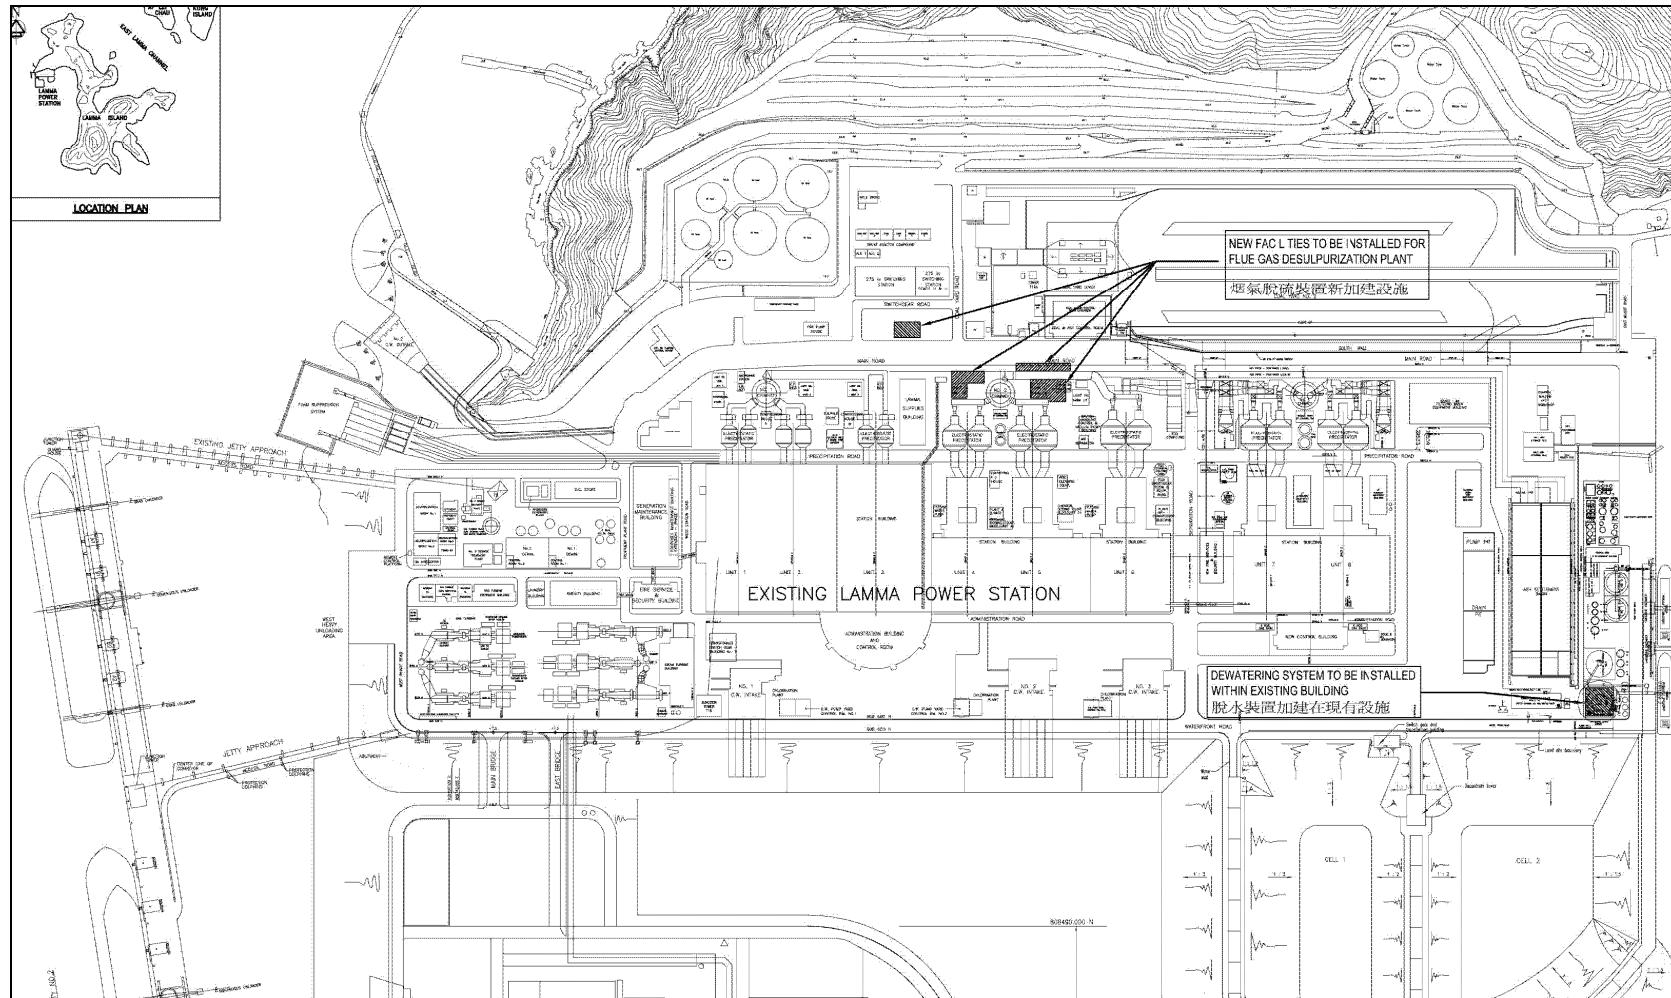


Figure 1.1a Location of New Facilities for L4 & L5 FGD Plants

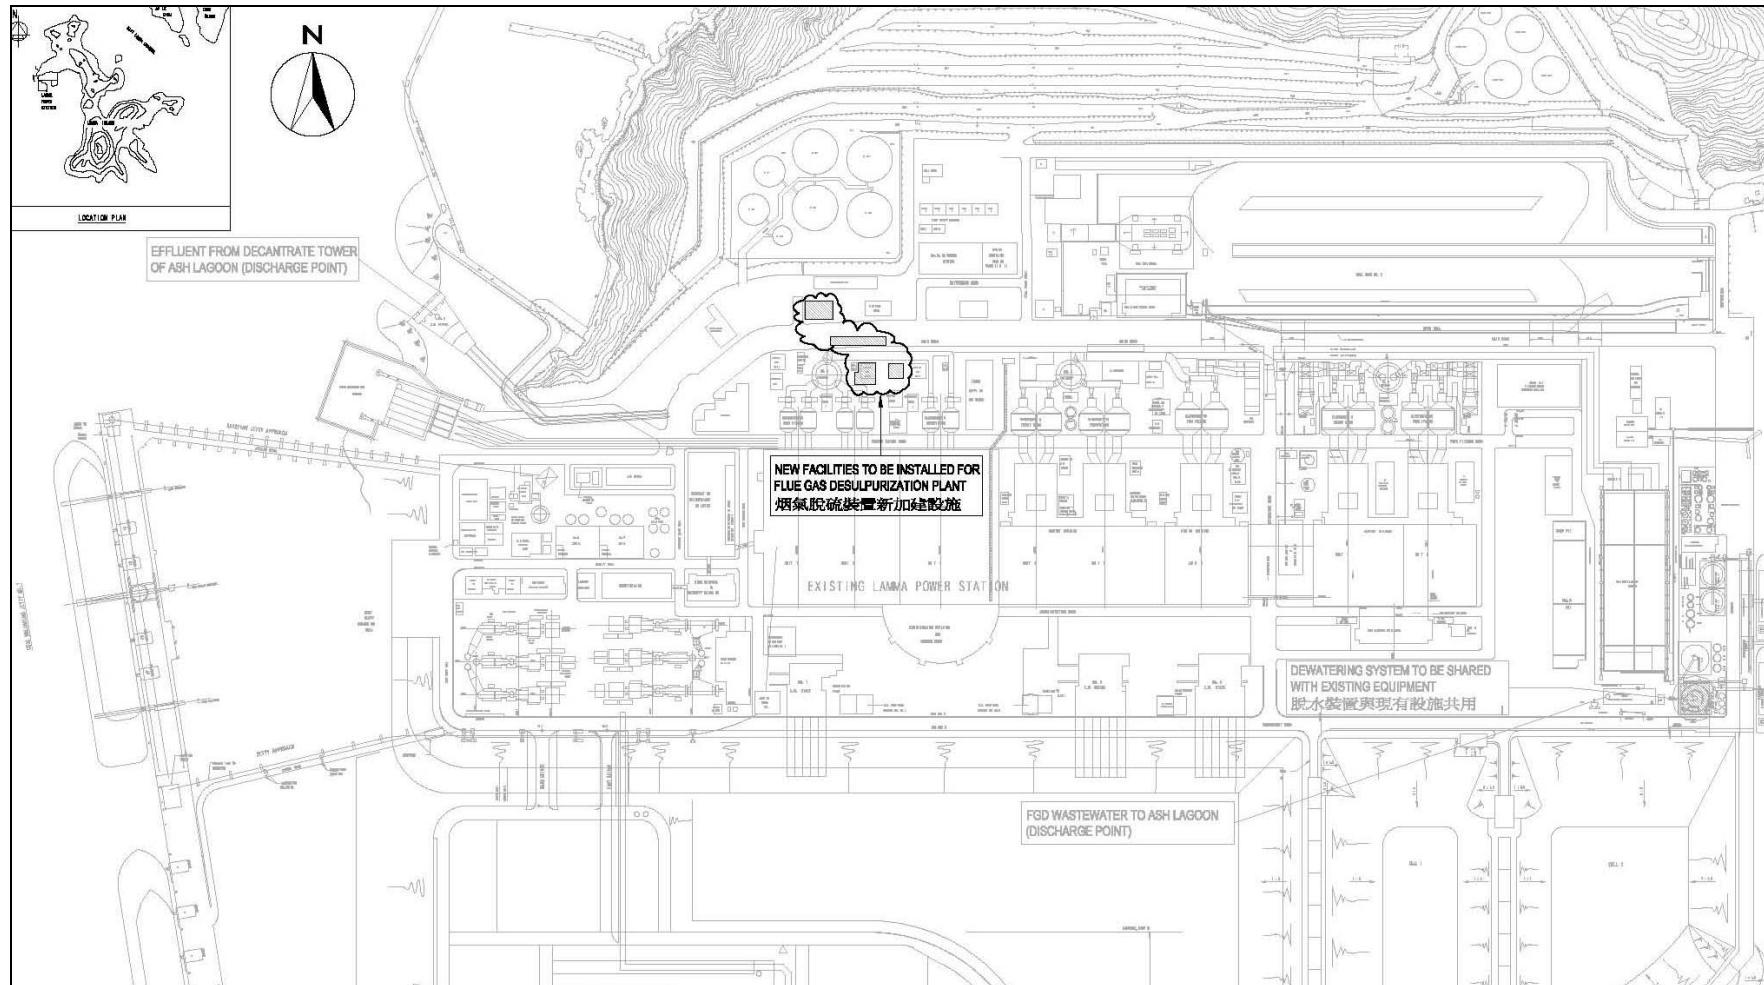


Figure 1.1b Location of New Facilities for L2 FGD Plant

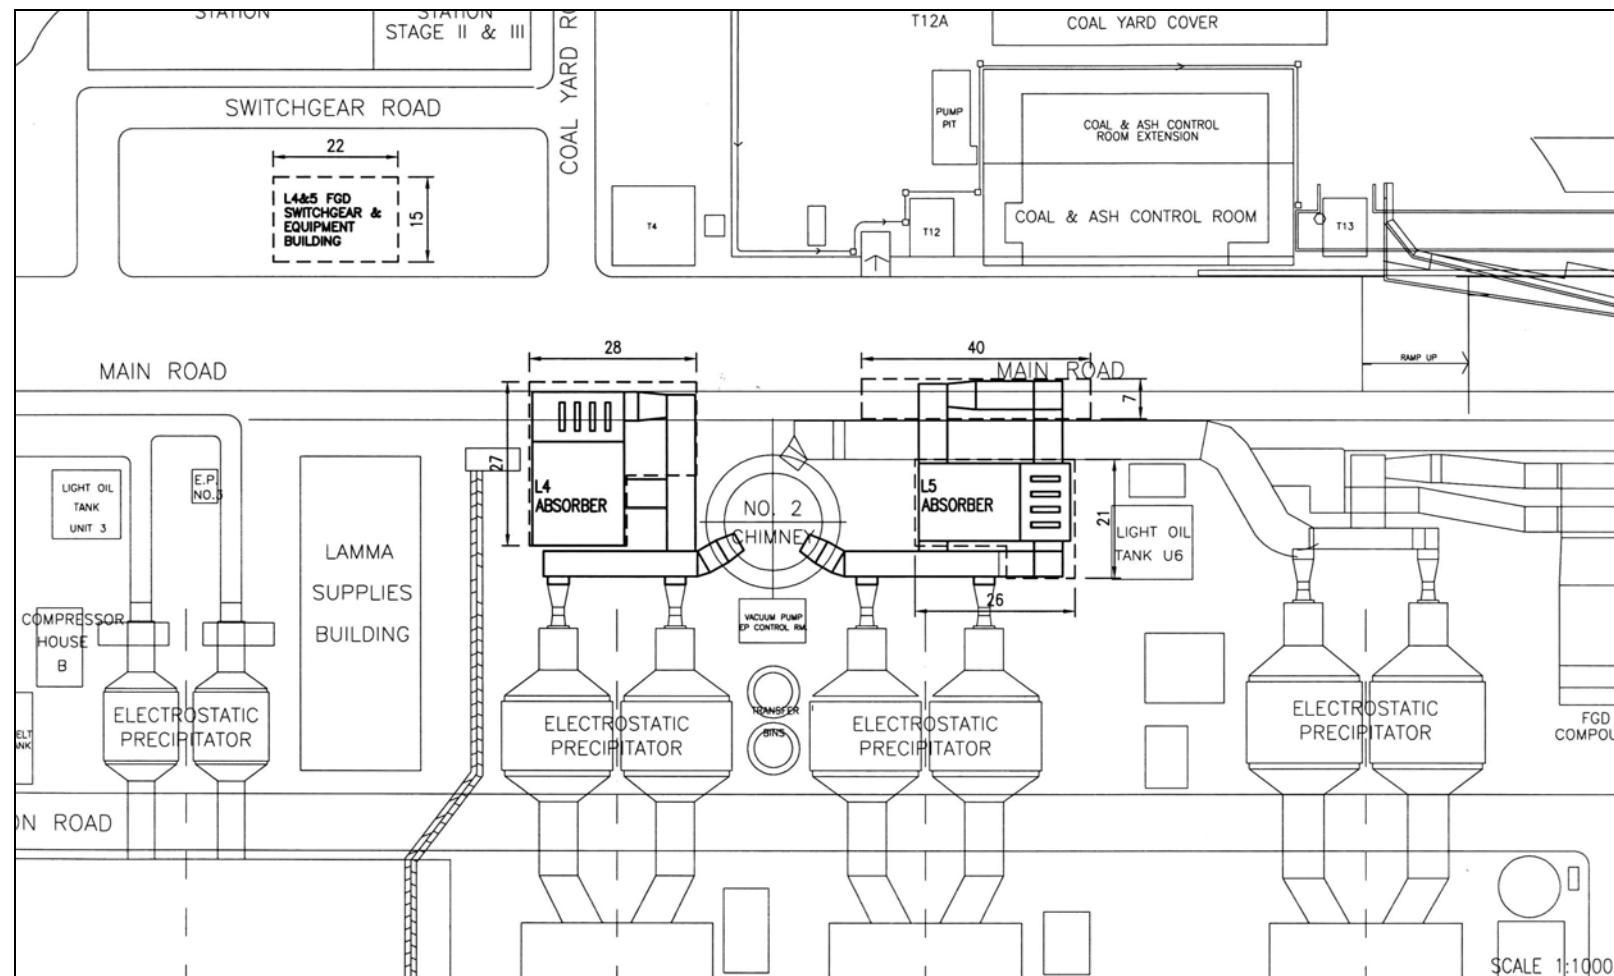


Figure 1.2a General Arrangement of L4 & L5 FGD Plants

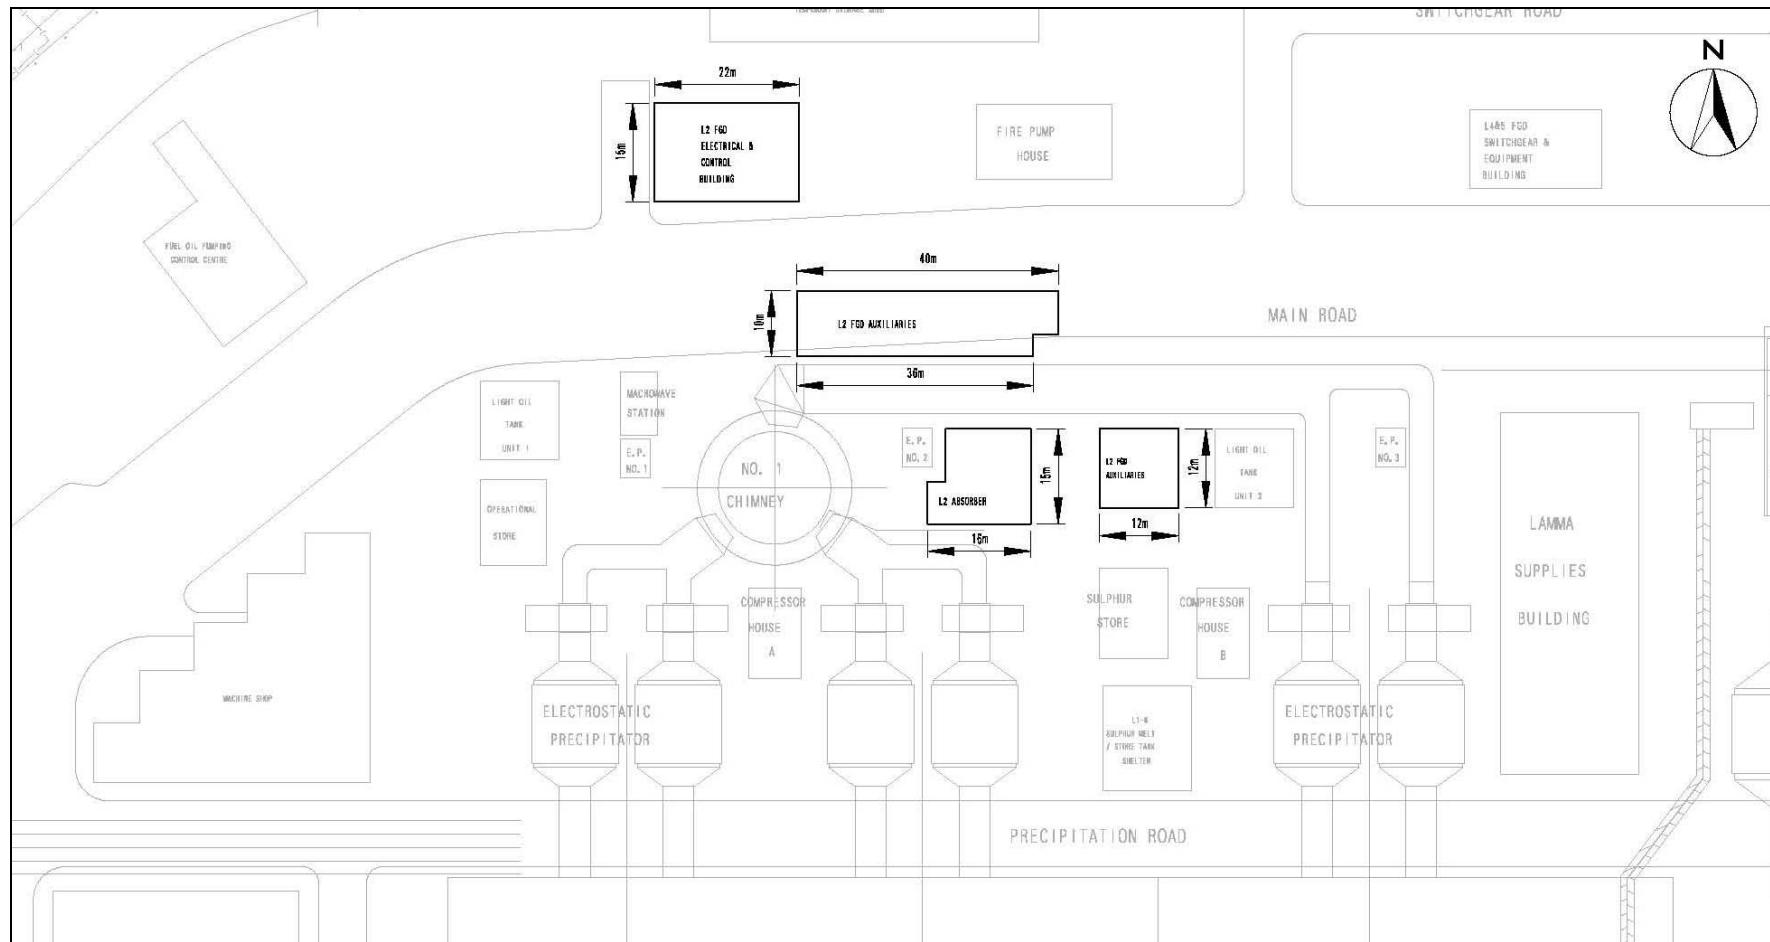


Figure 1.2b General Arrangement of L2 FGD Plant

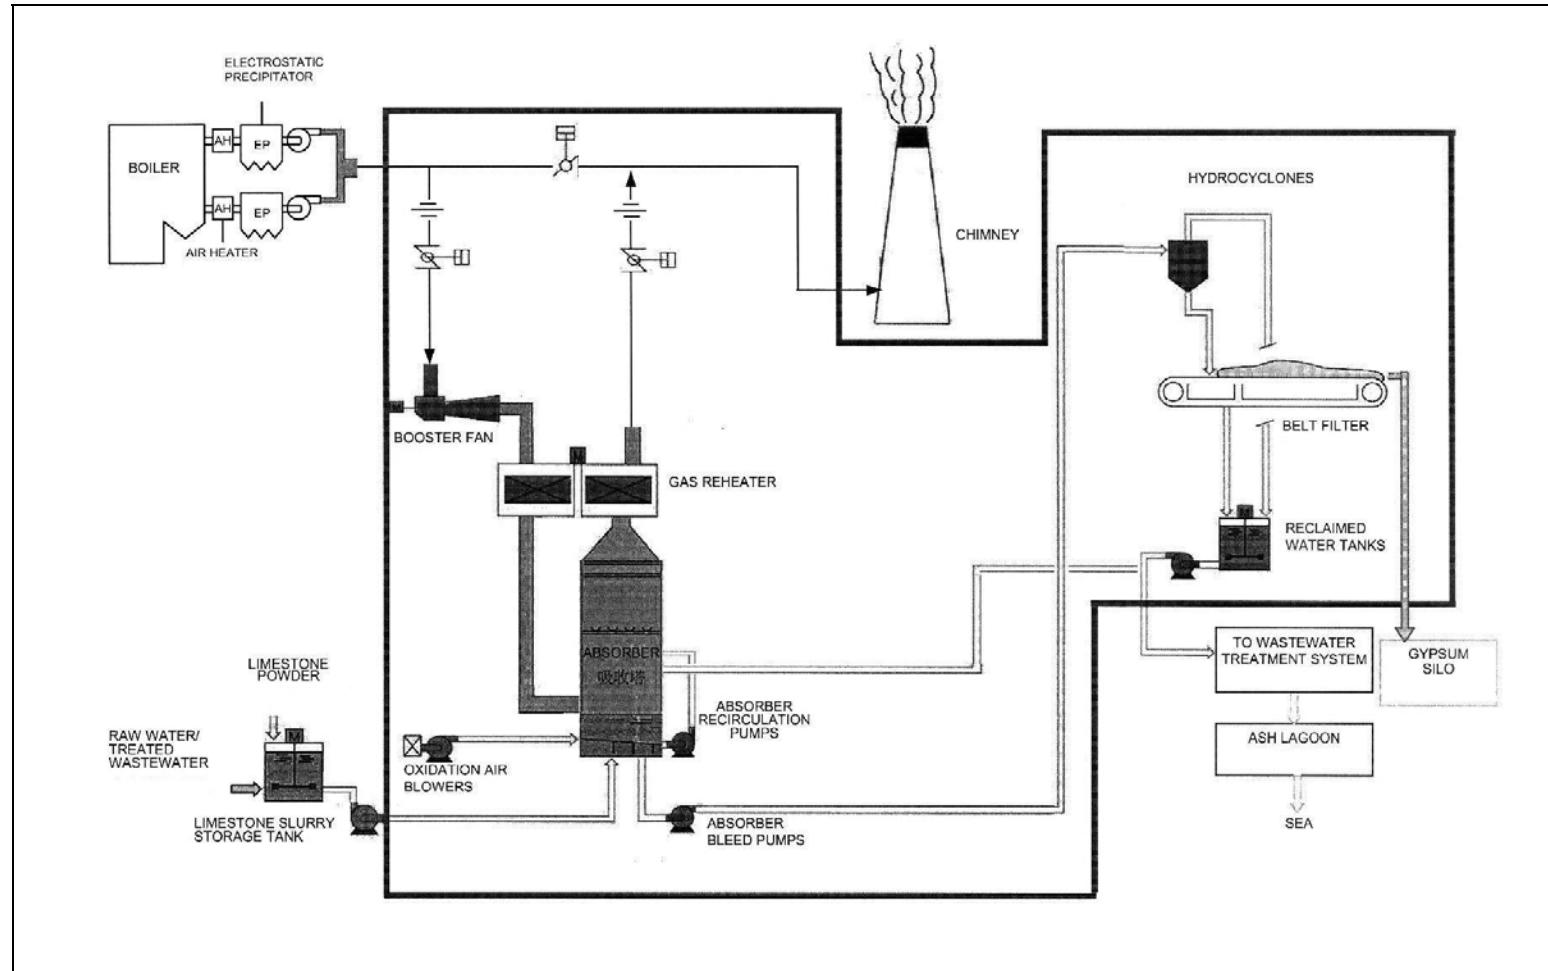


Figure 1.3 Schematic Diagram of the L2, L4 & L5 FGD Plant

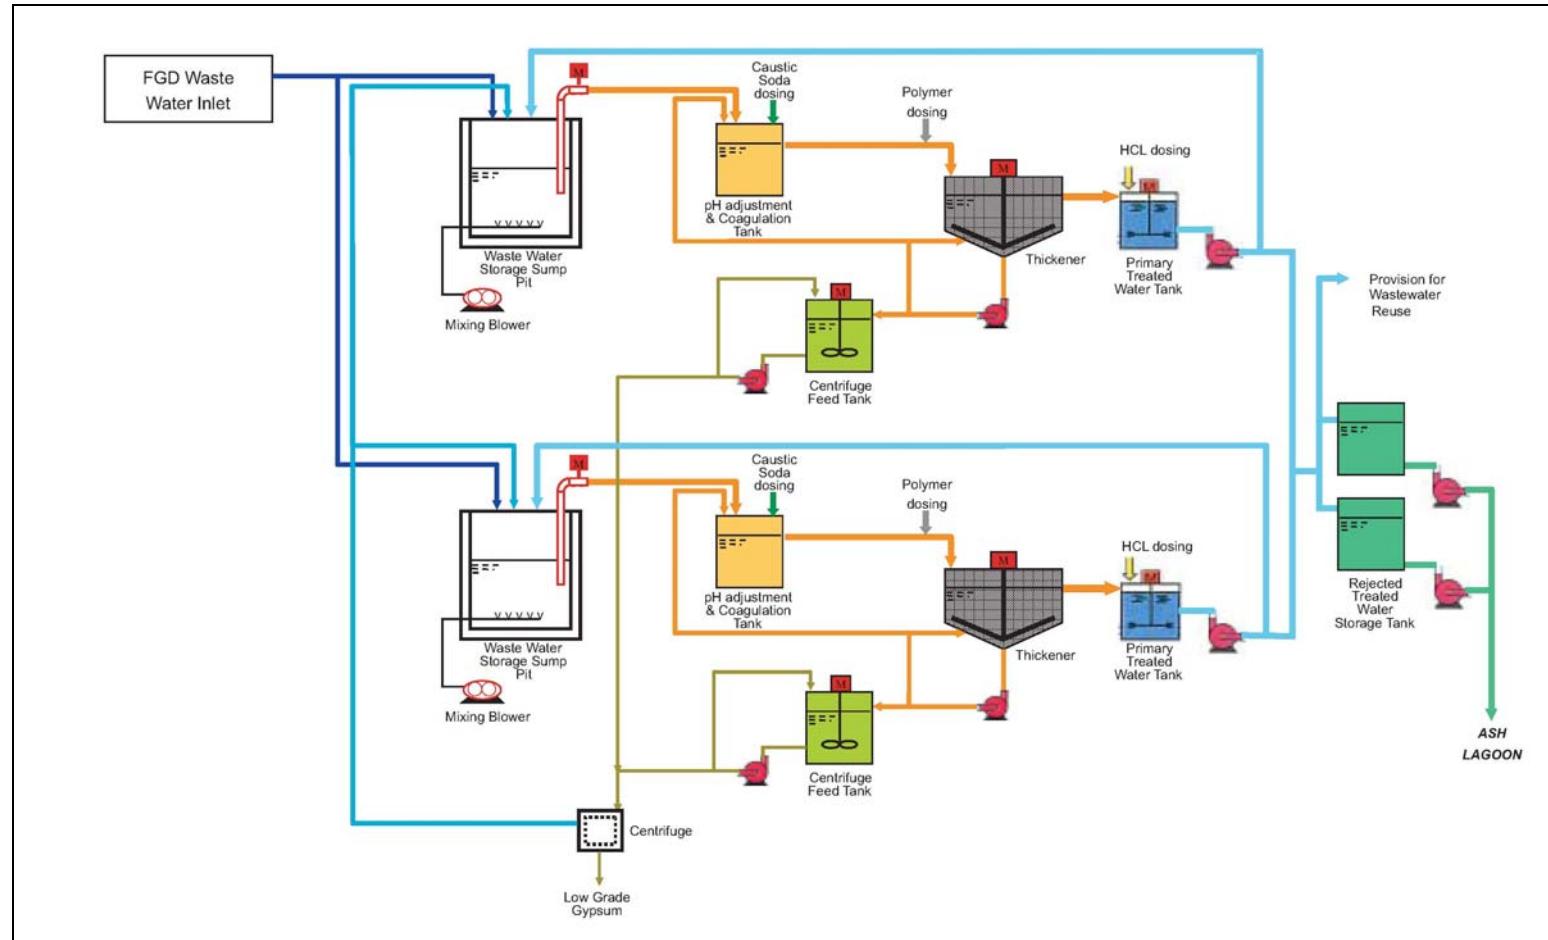


Figure 1.4 Simplified Schematic Diagram of FGD Wastewater Treatment Plant

Organization Chart

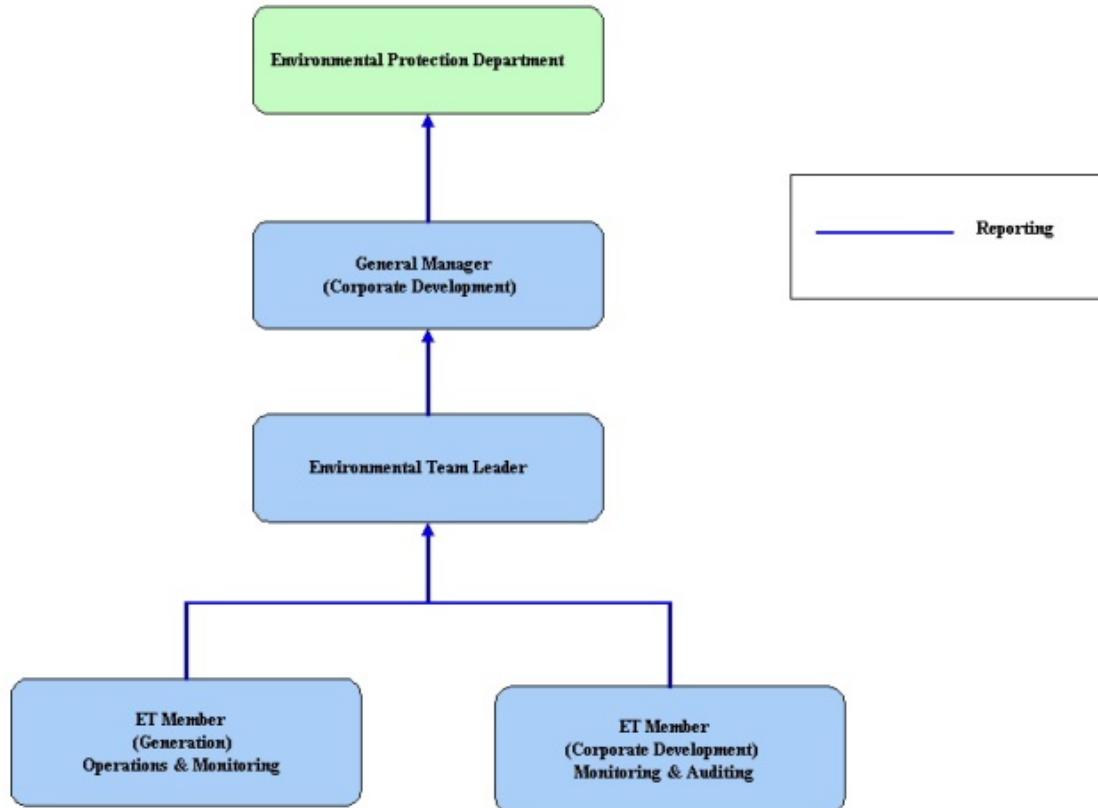


Figure 1.5 Organization Structure at Operational Phase of the Projects

2. AIR QUALITY

2.1 Monitoring Requirements

Since the Projects will bring a general air quality improvement, no additional EM&A activities are considered required, besides those already in place, such as those required by specified process licenses for the operation of the existing Lamma Power Station. Total Suspended Particulate (TSP) monitoring at East Gate and Reservoir area of Lamma Power Station is no longer required under the current SP Licence L-7-002(14). It is agreed with EPD that the results of continuous Respirable Suspended Particulate (RSP) monitoring at Lamma Power Station would be reported. In accordance with the requirements stipulated in the Specified Processes Licence issued under Air Pollution Control Ordinance, various operation parameters as stated in [Table 2.1](#) were monitored. Those parameters have to be checked against the Action/Limit Levels are shown in [Appendix A](#).

Table 2.1 Air Quality Monitoring Parameters and Frequency

Sources of Emission	Parameter	Frequency
Steam boilers L2, L4 & L5	Particulate	Once / year
	Particulate (Opacity)	Continuous
	SO2	Continuous
	NOx expressed as NO2 (For L4 and L5 only)	Continuous
Fugitive Dust (Coal, PFA, Limestone, gypsum)	Respirable Suspended Particulate	Continuous
Chimney emissions	Ambient air	Continuous at existing ambient air monitoring stations
	SO2	
	NO2	

2.2 Summary of Results and Observations

Monitoring of various parameters as listed in [Table 2.1](#) above was conducted during the operation of Units L2, L4 and L5 in the reporting period. A summary of monitoring data is shown in [Appendix B](#).

No Action/Limit Level exceedance was recorded in the reporting period.

3. WATER QUALITY

3.1 Monitoring Requirements

According to the EIA Report/ Project Profile for the Projects, the current monitoring programme for the Lamma Power Station can cover the Projects and no additional EM&A measures are required besides those already in place. Hence, the EM&A work on water quality should strictly follow the relevant monitoring requirements stipulated in the discharge licence for Ash Lagoon issued under the Water Pollution Control Ordinance (WPCO).

Water quality monitoring was carried out for FGD Waste Water Treatment Plant (WWTP) in the reporting period. The parameters stated in [Table 3.1](#) were monitored and checked against the Action/Limit Levels as given in [Appendix A](#).

Table 3.1 Water Quality Monitoring Parameters and Frequencies

Item	Parameters	Frequencies
1	pH	Daily
2	Suspended Solids	Daily
3	Iron	Monthly
4	Barium	Monthly
5	Mercury	Monthly
6	Cadmium	Monthly
7	Cyanide	Monthly
8	Total Phosphorus	Monthly
9	Total Nitrogen	Monthly

3.2 Summary of Results and Observations

Monitoring of various parameters as listed in [Table 3.1](#) above was carried out during the discharge of the WWTP in the reporting period. A summary of the data is shown in [Appendix C](#).

The data recorded for the monitoring parameters were all below their corresponding Action/Limit Levels. No Action/Limit level exceedance was recorded in the reporting period. The effluent quality was generally satisfactory.

4. ENVIRONMENTAL AUDIT

4.1 Review of Environmental Monitoring Procedures

The environmental monitoring procedures were regularly reviewed by the Environmental Team. No modification to the existing monitoring procedures was recommended.

4.2 Assessment of Environmental Monitoring Results

Monitoring results for Air Quality and Water Quality

The environmental monitoring results for air quality and water quality are presented in [Sections 2](#) and [3](#) respectively are summarized in [Table 4.1](#).

Table 4.1 Summary of Action/Limit Level Exceedances on Monitoring Parameters

Item	Parameter Monitored	Monitoring Period	No. of Exceedances In		Event/Action Plan Implementation Status and Results
			Action Level	Limit Level	
Air					
1	Annual analysis of dust particulate emission rates at chimney stacks.	01/07/24-30/09/24	N.A.	0	No PM stack sampling tests were conducted in the reporting period.
2	Continuous monitoring of opacity, NOx, SO2 and CO2 in the flue gas at the chimney stacks	01/07/24-30/09/24	0	0	
3	Ambient SO2 & NOx monitoring at the Peak, Queen Mary Hospital , Victoria Road, Chung Hom Kok, Ap Lei Chau and Cheung Chau.	01/07/24-30/09/24	0	0	
Water					
1	pH in WWTP Effluent	01/07/24-30/09/24	0	0	
2	Suspended Solids in WWTP Effluent	01/07/24-30/09/24	0	0	

Item	Parameter Monitored	Monitoring Period	No. of Exceedances In		Event/Action Plan Implementation Status and Results
			Action Level	Limit Level	
3	Iron in WWTP Effluent	01/07/24-30/09/24	0	0	
4	Barium in WWTP Effluent	01/07/24-30/09/24	0	0	
5	Mercury in WWTP Effluent	01/07/24-30/09/24	0	0	
6	Cadmium in WWTP Effluent	01/07/24-30/09/24	0	0	
7	Cyanide in WWTP Effluent	01/07/24-30/09/24	0	0	
8	Total Phosphorus in WWTP Effluent	01/07/24-30/09/24	0	0	
9	Total Nitrogen in WWTP Effluent	01/07/24-30/09/24	0	0	

Waste Management Records

The quantity of FGD gypsum and sludge collected for reuse by contractor in the reporting period are shown in [Table 4.2](#).

Table 4.2 Amount of Gypsum and Sludge Collected for Reuse by Contractor

Period	Amount of Gypsum Collected	Amount of Sludge Collected
July 2024	4,102.86 MT	36.68 MT
August 2024	4,750.07 MT	0 MT
September 2024	2,001.05 MT	49.35 MT

4.3 Status of Environmental Licensing and Permitting

All permits/licenses obtained as of September 2024 are summarised in [Table 4.3](#).

Table 4.3 Summary of Environmental Licensing and Permit Status

Description	Permit / Licence No.	Valid Period		Status
		From	To	
Environmental Permit for Units L4/5 FGD Plants Retrofit	EP-248/2006	25/04/2006	-	Valid
Environmental Permit for Unit L2 FGD Plant Retrofit	EP-287/2007	02/10/2007	-	Valid
Specified Process Licence issued under APCO	L-7-002(14)	01/01/2023	31/12/2024	Valid
WPCO discharge licence for Ash Lagoon	WT00039618-2021	11/02/2022	31/12/2026	Valid

4.4 Implementation Status of Environmental Mitigation Measures

Mitigation measures detailed in the EIA Report and EP are required to be implemented. A summary of the Environmental Mitigation Implementation Schedule (EMIS) is presented in [Appendix D](#).

4.5 Implementation Status of Event/Action Plan

A list of specific actions in the event of exceedances of the various threshold levels for specific emission and discharge sources is given in [Appendix A](#).

As no Action/Limit level exceedance was recorded, no action has been devised.

4.6 Implementation Status of Environmental Complaint Handling Procedures

During the reporting period, there was one environmental feedback case regarding Lamma Power Station as summarized in Table 4.4. The reported issue was not related to the project and was satisfactorily addressed.

Table 4.4 Environmental Complaint(s) / Feedback Cases(s) Received

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions / Actions Taken	Conclusion / Status
Reference: LFB20240701	A Lamma resident expressed concern about large deposit of rubbish being washed onto Tai Wan To Beach. He	The reported issue was neither caused by

Received: On 24/07/2024 (pm) Concerned: As received	believed the land belonged to HK Electric and urged the Company to make more effort to keep the beach clean. After an inspection by HK Electric, a reply was made to the enquirer, clarifying that although the beach was not under the ownership or responsibility of HK Electric, the Company was also concerned about the state of this adjacent beach and would participate in the clean-up operations. The enquirer was satisfied with the Company's response.	HK Electric nor under its responsibility. It was satisfactorily addressed. Case closed.
--	---	---

Table 4.5 Outstanding Environmental Complaint(s) / Feedback Case(s) Carried Over

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions / Actions Taken	Conclusion / Status
-	-	-

5. FUTURE KEY ISSUES

5.1 Outage Plan for the coming 3 months

No major outage planned in the coming 3 months

5.2 Key issues for the coming 3 months

Key issues to be considered in the coming 3 months include:

Air Impact

- To continuously carry out the air quality monitoring for Units L2, L4 and L5 (if emergency generation is required).

Water Impact

- To continuously carry out the water quality monitoring for FGD Waste Water Treatment Plant.

6. CONCLUSION

Environmental monitoring was performed as required in the reporting period from July to September 2024. All monitoring results were checked and reviewed.

No Action/Limit level exceedance on air quality parameters were recorded in the reporting period.

No Action/Limit level exceedance on water quality parameters were recorded in the reporting period.

Environmental mitigation measures recommended in the EIA Report and EP were implemented in the reporting period.

During the reporting period, there was one environmental feedback case regarding Lamma Power Station as summarized in Section 4.6. The reported issue was not related to the project and was satisfactorily addressed.

No prosecution was received for the Projects in the reporting period.

The environmental performance of the Projects was generally satisfactory.

Appendix A Event/Action Plans in Response to Exceedance of AL Levels

A.1 Air

Source of Emissions	Parameters to be Monitored	Frequency	Concentration Not to Be Exceeded	Action	Limit	Proposed Action
Steam boilers L2, L4 and L5	Particulate Particulate (Opacity) SO2 NOx expressed as NO2 (For L4 and L5 only)	once/year continuous continuous continuous	50 mg/Nm ³ 40% (bihourly) 200 mg/Nm ³ (1h) 615 mg/Nm ³ (1h)	- 35 190 585	50 40 200 615	ET Leader informs Generation Division at action level. Maintenance initiated. Temporary load shift until pollution control equipment repaired and reinstated. Report to EPD.
Chimney emissions	Ambient air SO2 NO2	Continuous at existing ambient air monitoring stations	800 ($\mu\text{g}/\text{m}^3$) (1h) 300 ($\mu\text{g}/\text{m}^3$) (1h)	- -	800 300	ET to review data on post-hoc basis and check for possible power station contribution.

A.2 Water

Source of Discharges	Parameters to be Monitored	Frequency	Concentration Not to Be Exceeded	Action	Limit	Proposed Action
FGD Wastewater Treatment Plant	pH	Daily	6-9	-	6-9	If pH exceeds limit level, consideration to be given to adjust chemical dosing. ET Leader inform Generation Division and investigation be initiated to identify and remedy cause.
	Suspended Solids	Daily	30 mg/L	25	30	
	Iron	Monthly	4 mg/L	3.6	4	For all other parameters except pH, Generation Division to be informed, frequency of monitoring to be increased, and investigations to be initiated to identify cause and remedy if concentration exceeds action level.
	Barium	Monthly	1.5 mg/L	1.3	1.5	If problem persists to exceed the limit level, ET Leader verbally informs EPD and ensures remedial actions implemented.
	Mercury	Monthly	0.005 mg/L	0.0045	0.005	
	Cadmium	Monthly	0.005 mg/L	0.0045	0.005	
	Cyanide	Monthly	0.1 mg/L	0.09	0.1	
	Total Phosphorus	Monthly	8 mg/L	7.2	8	
	Total Nitrogen	Monthly	400 mg/L	360	400	

Appendix B

Air Quality Monitoring Results

B.1 Ambient Respirable Suspended Particulate Monitoring at Lamma Power Station

Date: Third Quarter of 2024 (July – September)

Date	RSP concentration ($\mu\text{g}/\text{m}^3$)	
	Reservoir	East Gate
01/07/2024	55	29
02/07/2024	50	20
03/07/2024	14	16
04/07/2024	22	11
05/07/2024	18	18
06/07/2024	23	13
07/07/2024	15	13
08/07/2024	27	10
09/07/2024	27	13
10/07/2024	26	17
11/07/2024	18	12
12/07/2024	19	15
13/07/2024	25	15
14/07/2024	34	18
15/07/2024	40	19
16/07/2024	32	12
17/07/2024	40	22
18/07/2024	39	13
19/07/2024	46	26
20/07/2024	44	26
21/07/2024	26	31
22/07/2024	44	27
23/07/2024	27	29
24/07/2024	48	35
25/07/2024	50	35
26/07/2024	55	38
27/07/2024	22	17
28/07/2024	17	16
29/07/2024	16	16
30/07/2024	16	11
31/07/2024	31	33

Date	RSP concentration ($\mu\text{g}/\text{m}^3$)	
	Reservoir	East Gate
01/08/2024	16	35
02/08/2024	12	24
03/08/2024	22	24
04/08/2024	18	27
05/08/2024	14	25
06/08/2024	24	24
07/08/2024	41	21
08/08/2024	26	14
09/08/2024	28	18
10/08/2024	54	22
11/08/2024	41	16
12/08/2024	27	14
13/08/2024	13	9
14/08/2024	18	15
15/08/2024	12	10
16/08/2024	13	12
17/08/2024	16	12
18/08/2024	17	14
19/08/2024	24	15
20/08/2024	48	35
21/08/2024	27	20
22/08/2024	48	28
23/08/2024	25	20
24/08/2024	31	18
25/08/2024	14	10
26/08/2024	16	22
27/08/2024	30	29
28/08/2024	29	34
29/08/2024	33	34
30/08/2024	18	26
31/08/2024	11	12

Date	RSP concentration ($\mu\text{g}/\text{m}^3$)	
	Reservoir	East Gate
01/09/2024	16	12
02/09/2024	20	19
03/09/2024	36	43
04/09/2024	20	25
05/09/2024	38	24
06/09/2024	21	19
07/09/2024	22	32
08/09/2024	12	17
09/09/2024	9	9
10/09/2024	14	19
11/09/2024	18	15
12/09/2024	23	14
13/09/2024	30	26
14/09/2024	32	28
15/09/2024	34	34
16/09/2024	16	14
17/09/2024	21	21
18/09/2024	33	26
19/09/2024	53	34
20/09/2024	12	29
21/09/2024	23	21
22/09/2024	15	11
23/09/2024	22	22
24/09/2024	20	21
25/09/2024	23	24
26/09/2024	23	27
27/09/2024	46	42
28/09/2024	28	37
29/09/2024	27	26
30/09/2024	75	84

B.2 Unit L2, L4 and L5 Stack Monitoring at Lamma Power Station

B.2.1 Monthly Summary of Stack NOx and SO2 for Unit L5

Date	Daily Maximum		
	SO2 concentration (mg/Nm ³) [#]	NOx concentration (mg/Nm ³) [#]	Opacity (%)
01/07/2024	*	*	*
02/07/2024	*	*	*
03/07/2024	*	*	*
04/07/2024	*	*	*
05/07/2024	*	*	*
06/07/2024	*	*	*
07/07/2024	*	*	*
08/07/2024	*	*	*
09/07/2024	*	*	*
10/07/2024	*	*	*
11/07/2024	*	*	*
12/07/2024	*	*	*
13/07/2024	*	*	*
14/07/2024	*	*	*
15/07/2024	*	*	*
16/07/2024	*	*	*
17/07/2024	*	*	*
18/07/2024	*	*	*
19/07/2024	*	*	*
20/07/2024	*	*	*
21/07/2024	*	*	*
22/07/2024	*	*	*
23/07/2024	*	*	*
24/07/2024	*	*	*
25/07/2024	*	*	*
26/07/2024	*	*	*
27/07/2024	*	*	*
28/07/2024	*	*	*
29/07/2024	*	*	*
30/07/2024	*	*	*
31/07/2024	*	*	*

Date	Daily Maximum		
	SO ₂ concentration (mg/Nm ³) [#]	NO _x concentration (mg/Nm ³) [#]	Opacity (%)
01/08/2024	*	*	*
02/08/2024	*	*	*
03/08/2024	*	*	*
04/08/2024	*	*	*
05/08/2024	*	*	*
06/08/2024	*	*	*
07/08/2024	*	*	*
08/08/2024	*	*	*
09/08/2024	*	*	*
10/08/2024	*	*	*
11/08/2024	*	*	*
12/08/2024	*	*	*
13/08/2024	*	*	*
14/08/2024	*	*	*
15/08/2024	*	*	*
16/08/2024	*	*	*
17/08/2024	*	*	*
18/08/2024	*	*	*
19/08/2024	*	*	*
20/08/2024	*	*	*
21/08/2024	*	*	*
22/08/2024	*	*	*
23/08/2024	*	*	*
24/08/2024	*	*	*
25/08/2024	*	*	*
26/08/2024	*	*	*
27/08/2024	*	*	*
28/08/2024	*	*	*
29/08/2024	*	*	*
30/08/2024	*	*	*
31/08/2024	*	*	*

	01/09/2024 02/09/2024	Daily Maximum		
		SO2 concentration (mg/Nm ³) [#]	NOx concentration (mg/Nm ³) [#]	Opacity (%)
03/09/2024	*	*	*	*
04/09/2024	*	*	*	*
05/09/2024	*	*	*	*
06/09/2024	*	*	*	*
07/09/2024	*	*	*	*
08/09/2024	*	*	*	*
09/09/2024	*	*	*	*
10/09/2024	*	*	*	*
11/09/2024	*	*	*	*
12/09/2024	*	*	*	*
13/09/2024	*	*	*	*
14/09/2024	*	*	*	*
15/09/2024	*	*	*	*
16/09/2024	*	*	*	*
17/09/2024	*	*	*	*
18/09/2024	*	*	*	*
19/09/2024	*	*	*	*
20/09/2024	*	*	*	*
21/09/2024	*	*	*	*
22/09/2024	*	*	*	*
23/09/2024	*	*	*	*
24/09/2024	*	*	*	*
25/09/2024	*	*	*	*
26/09/2024	*	*	*	*
27/09/2024	*	*	*	*
28/09/2024	*	*	*	*
29/09/2024	*	*	*	*
30/09/2024	*	*	*	*
01/09/2024	*	*	*	*
02/09/2024	*	*	*	*

Note: # - Hourly average value. Expressed as at 0°C, 101.325kPa, dry and corrected to 12% CO₂ condition.

* - Unit L5 was not on load

B.2.2 Monthly Summary of Stack NOx and SO2 for Unit L4

Date	Daily Maximum		
	SO2 concentration (mg/Nm ³) [#]	NOx concentration (mg/Nm ³) [#]	Opacity (%)
01/07/2024	*	*	*
02/07/2024	*	*	*
03/07/2024	*	*	*
04/07/2024	*	*	*
05/07/2024	*	*	*
06/07/2024	*	*	*
07/07/2024	*	*	*
08/07/2024	*	*	*
09/07/2024	*	*	*
10/07/2024	*	*	*
11/07/2024	*	*	*
12/07/2024	*	*	*
13/07/2024	*	*	*
14/07/2024	*	*	*
15/07/2024	*	*	*
16/07/2024	*	*	*
17/07/2024	*	*	*
18/07/2024	*	*	*
19/07/2024	*	*	*
20/07/2024	*	*	*
21/07/2024	*	*	*
22/07/2024	*	*	*
23/07/2024	*	*	*
24/07/2024	*	*	*
25/07/2024	*	*	*
26/07/2024	*	*	*
27/07/2024	*	*	*
28/07/2024	*	*	*
29/07/2024	*	*	*
30/07/2024	*	*	*
31/07/2024	*	*	*

Date	Daily Maximum		
	SO ₂ concentration (mg/Nm ³) [#]	NO _x concentration (mg/Nm ³) [#]	Opacity (%)
01/08/2024	*	*	*
02/08/2024	*	*	*
03/08/2024	*	*	*
04/08/2024	*	*	*
05/08/2024	*	*	*
06/08/2024	*	*	*
07/08/2024	*	*	*
08/08/2024	*	*	*
09/08/2024	*	*	*
10/08/2024	*	*	*
11/08/2024	*	*	*
12/08/2024	*	*	*
13/08/2024	*	*	*
14/08/2024	*	*	*
15/08/2024	*	*	*
16/08/2024	*	*	*
17/08/2024	*	*	*
18/08/2024	*	*	*
19/08/2024	*	*	*
20/08/2024	*	*	*
21/08/2024	*	*	*
22/08/2024	*	*	*
23/08/2024	*	*	*
24/08/2024	*	*	*
25/08/2024	*	*	*
26/08/2024	*	*	*
27/08/2024	*	*	*
28/08/2024	*	*	*
29/08/2024	*	*	*
30/08/2024	*	*	*
31/08/2024	*	*	*

Date	Daily Maximum		
	SO ₂ concentration (mg/Nm ³) [#]	NOx concentration (mg/Nm ³) [#]	Opacity (%)
01/09/2024	*	*	*
02/09/2024	*	*	*
03/09/2024	*	*	*
04/09/2024	*	*	*
05/09/2024	*	*	*
06/09/2024	*	*	*
07/09/2024	*	*	*
08/09/2024	*	*	*
09/09/2024	*	*	*
10/09/2024	*	*	*
11/09/2024	*	*	*
12/09/2024	*	*	*
13/09/2024	*	*	*
14/09/2024	*	*	*
15/09/2024	*	*	*
16/09/2024	*	*	*
17/09/2024	*	*	*
18/09/2024	*	*	*
19/09/2024	*	*	*
20/09/2024	*	*	*
21/09/2024	*	*	*
22/09/2024	*	*	*
23/09/2024	*	*	*
24/09/2024	*	*	*
25/09/2024	*	*	*
26/09/2024	*	*	*
27/09/2024	*	*	*
28/09/2024	*	*	*
29/09/2024	*	*	*
30/09/2024	*	*	*

Note: # - Hourly average value. Expressed as at 0°C, 101.325kPa, dry and corrected to 12% CO₂ condition.

* - Unit L4 was not on load.

B.2.3 Monthly Summary of Stack SO₂ for Unit L2

Date	Daily Maximum	
	SO ₂ concentration (mg/Nm ³) [#]	Opacity (%)
01/07/2024	*	*
02/07/2024	*	*
03/07/2024	*	*
04/07/2024	*	*
05/07/2024	*	*
06/07/2024	*	*
07/07/2024	*	*
08/07/2024	*	*
09/07/2024	*	*
10/07/2024	*	*
11/07/2024	*	*
12/07/2024	*	*
13/07/2024	*	*
14/07/2024	*	*
15/07/2024	*	*
16/07/2024	*	*
17/07/2024	*	*
18/07/2024	*	*
19/07/2024	*	*
20/07/2024	*	*
21/07/2024	*	*
22/07/2024	*	*
23/07/2024	*	*
24/07/2024	*	*
25/07/2024	*	*
26/07/2024	*	*
27/07/2024	*	*
28/07/2024	*	*
29/07/2024	*	*
30/07/2024	*	*
31/07/2024	*	*

Date	Daily Maximum	
	SO2 concentration (mg/Nm ³) [#]	Opacity (%)
01/08/2024	*	*
02/08/2024	*	*
03/08/2024	*	*
04/08/2024	*	*
05/08/2024	*	*
06/08/2024	*	*
07/08/2024	*	*
08/08/2024	*	*
09/08/2024	*	*
10/08/2024	*	*
11/08/2024	*	*
12/08/2024	*	*
13/08/2024	*	*
14/08/2024	*	*
15/08/2024	*	*
16/08/2024	*	*
17/08/2024	*	*
18/08/2024	*	*
19/08/2024	*	*
20/08/2024	*	*
21/08/2024	*	*
22/08/2024	*	*
23/08/2024	*	*
24/08/2024	*	*
25/08/2024	*	*
26/08/2024	*	*
27/08/2024	*	*
28/08/2024	*	*
29/08/2024	*	*
30/08/2024	*	*
31/08/2024	*	*

Date	Daily Maximum	
	SO2 concentration (mg/Nm ³) [#]	Opacity (%)
01/09/2024	*	*
02/09/2024	*	*
03/09/2024	*	*
04/09/2024	*	*
05/09/2024	*	*
06/09/2024	*	*
07/09/2024	*	*
08/09/2024	*	*
09/09/2024	*	*
10/09/2024	*	*
11/09/2024	*	*
12/09/2024	*	*
13/09/2024	*	*
14/09/2024	*	*
15/09/2024	*	*
16/09/2024	*	*
17/09/2024	*	*
18/09/2024	*	*
19/09/2024	*	*
20/09/2024	*	*
21/09/2024	*	*
22/09/2024	*	*
23/09/2024	*	*
24/09/2024	*	*
25/09/2024	*	*
26/09/2024	*	*
27/09/2024	*	*
28/09/2024	*	*
29/09/2024	*	*
30/09/2024	*	*

Note: # - Hourly average value. Expressed as at 0°C, 101.325kPa, dry and corrected to 12% CO₂ condition.

* - Unit L2 was not on load.

B.2.4 Summary of Annual Stack Particulate Sampling

No stack particulate sampling was conducted for Unit L5 in the period July to September 2024. Unit L2 and Unit L4 were retired in October 2022 and January 2024 respectively.

B.3 Ambient SO₂ and NO₂ monitoring Data at Southern District and Cheung Chau

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: JULY

STATION : VICTORIA PEAK
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	
2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	
3	1	1	1	1	1	1	1	1	1	1	1	1	1	1	2	2	2	2	1	0	1	1	1	1	1	
4	1	1	1	1	1	1	1	1	1	1	1	1	1	2	2	2	3	2	2	1	1	1	1	1	2	
5	1	1	1	1	1	1	1	1	2	2	4	3	3	3	4	4	3	2	2	1	1	1	1	1	2	
6	1	1	1	1	1	1	1	2	2	1	2	2	2	2	2	3	2	2	2	1	1	1	1	2	2	
7	1	1	1	1	1	1	1	1	2	2	2	2	2	3	3	2	3	2	1	1	1	2	1	1	2	
8	1	1	1	1	1	1	1	1	2	2	2	1	2	2	2	3	3	3	2	1	1	2	1	1	2	
9	1	2	2	2	1	1	1	2	3	3	5	3	3	3	3	3	3	2	2	1	2	2	2	2	2	
10	2	2	2	2	2	2	2	3	3	4	M	5	3	3	3	4	4	4	3	1	2	3	4	3	3	
11	3	3	3	4	3	3	3	3	4	4	4	4	4	4	4	5	5	5	4	4	4	4	4	5	4	
12	5	4	4	4	4	4	4	4	4	3	4	4	4	2	5	4	4	3	3	3	3	3	3	4	4	
13	3	3	3	3	4	3	3	4	5	5	4	5	6	6	8	6	4	3	4	5	M	M	M	M	4	
14	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	
15	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	
16	0	0	1	1	1	1	0	0	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	1
17	1	1	1	1	1	0	1	0	1	1	1	1	1	1	2	1	2	1	1	2	1	1	1	1	2	1
18	2	2	1	1	2	2	0	1	2	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
19	1	1	1	1	1	1	1	1	1	1	1	1	1	2	1	1	2	1	1	1	1	1	1	1	1	1
20	1	1	1	1	0	1	1	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
21	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	1	1	1	0	1	1	0	0
22	1	1	1	1	1	1	0	1	1	1	1	1	1	2	2	2	2	1	1	1	1	1	1	1	2	1
23	1	1	1	1	1	1	1	1	1	2	2	4	3	2	3	2	3	3	1	2	2	2	2	2	2	2
24	2	2	2	2	1	2	2	2	2	2	2	3	4	3	3	4	5	2	2	2	2	2	2	2	2	2
25	2	2	2	2	2	2	2	2	3	2	3	4	4	4	3	3	3	2	2	2	2	2	2	2	2	2
26	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
27	2	2	2	2	1	2	1	1	2	2	2	M	2	2	2	2	2	1	2	1	1	1	1	1	2	1
28	1	1	1	2	1	1	1	1	1	1	1	1	1	2	1	1	1	1	1	1	1	1	1	1	2	1
29	2	1	2	2	1	1	2	1	1	2	2	1	1	1	2	1	2	2	1	1	1	1	2	1	2	1
30	2	1	1	2	1	2	2	1	1	2	2	2	2	2	2	2	1	2	2	2	2	2	2	1	1	2
31	1	2	2	1	2	2	1	1	2	1	2	1	2	1	2	2	2	2	2	2	2	2	2	2	2	2

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES				
		50	90	95	98	99	0	-	8	0	-	4	2				VALID	DATA	ABOVE	LIMIT	LEVEL
2	1	2	1	3	4	5	5	0	-	8	0	-	4	2	94	0	0	0	0	0	0

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : VICTORIA PEAK
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	0	0	0	0	0	0	1	0	0	0	1	1	0	0	2	1	1	2	0	0	0	0	0	0	0	
2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	1	1	0	0	0	0	3	0	
3	7	M	1	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
4	0	0	0	0	0	0	0	1	0	1	1	0	2	6	1	0	1	2	2	5	5	6	5	1	2	
5	0	0	0	0	3	0	3	2	5	9	5	3	1	2	1	3	6	3	1	0	0	0	0	0	2	
6	0	0	0	0	0	0	0	1	1	0	0	3	1	0	0	0	0	0	0	2	2	0	0	0	0	
7	0	0	0	0	0	0	1	0	0	1	0	0	0	0	0	0	0	2	0	1	5	1	1	0	1	
8	0	0	0	0	0	0	0	1	0	0	0	1	2	0	0	2	0	0	1	0	1	1	0	0	0	
9	1	2	0	0	0	0	0	2	9	4	8	5	0	1	0	0	0	0	2	2	1	1	0	0	3	2
10	3	0	0	0	0	0	0	1	2	0	2	M	1	0	1	0	0	0	1	2	0	1	0	2	0	1
11	2	0	0	0	0	0	0	0	0	0	1	0	0	0	0	2	0	1	1	0	0	2	0	2	0	
12	6	2	0	1	1	0	0	2	0	0	0	1	0	0	2	3	0	2	3	1	1	1	1	0	1	
13	0	0	0	0	0	0	0	0	2	1	0	0	0	0	0	2	3	2	2	1	3	1	0	0	1	
14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	
15	1	0	0	0	0	0	0	0	0	0	1	3	1	0	0	0	0	0	0	0	0	0	0	0	0	
16	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	
17	0	M	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	
18	0	0	0	0	0	0	0	0	0	0	0	0	0	1	3	2	0	0	0	0	0	0	0	0	0	
19	0	0	0	0	0	0	0	0	M	3	2	0	0	0	0	1	0	0	0	0	0	0	0	0	0	
20	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
21	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	M	M	M	1	5	1	1	2	1	3	1	
23	1	0	3	1	0	1	1	3	3	4	6	8	2	1	0	2	8	4	3	2	2	2	2	3	1	
24	1	0	0	1	1	1	2	1	3	9	8	7	10	10	21	17	19	18	8	5	2	2	3	6	6	
25	6	2	2	3	5	2	2	5	4	6	4	6	6	4	2	3	6	8	4	1	1	3	1	3	4	
26	3	1	1	1	1	1	0	0	2	2	3	3	2	2	2	5	5	11	11	10	4	2	5	2	3	
27	1	1	2	3	0	2	1	1	2	2	7	M	4	9	3	8	5	12	7	3	2	1	1	0	3	
28	0	0	0	0	0	0	0	0	0	1	2	1	5	1	2	4	2	1	0	1	0	1	1	1	1	
29	0	0	0	0	0	0	0	0	0	0	1	1	2	1	6	3	2	0	0	1	0	0	1	1	1	
30	1	0	0	0	0	1	0	1	0	1	2	2	3	3	6	3	9	14	13	4	5	4	1	1	3	
31	0	M	3	0	0	0	1	1	1	1	3	3	0	7	2	4	2	4	3	2	2	2	3	1	2	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	ABOVE	LIMIT				0	0	0
2	0	1	0	3	6	9	11	0	-	21	0	-	6	2	99				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	1	3	3	1	3	2	1	1	1	2	4	2	3	0	3	3	4	5	6	4	5	4	6	6	3
2	5	4	3	2	2	3	2	1	1	0	1	1	1	1	3	4	7	1	8	5	2	3	2	2	3
3	3	1	3	2	2	2	1	0	1	1	0	1	2	0	4	1	0	1	2	5	2	1	1	0	2
4	0	0	0	0	0	0	0	0	0	2	0	0	0	1	7	0	0	1	3	3	4	1	0	0	1
5	1	0	1	0	0	0	0	0	1	5	1	1	0	0	2	0	0	1	2	3	0	0	0	0	1
6	0	0	0	0	0	1	1	0	0	0	1	0	0	0	0	0	0	0	2	3	1	0	0	0	0
7	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	2	0	0	0	0	0
8	2	2	2	2	2	2	2	1	1	0	3	0	1	1	4	2	2	0	3	4	2	2	2	0	2
9	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	1	3	1	0	0	0	0
10	2	2	2	3	1	1	1	2	1	0	0	1	3	1	4	4	1	0	3	4	2	1	0	0	2
11	0	0	0	0	0	1	2	1	1	2	0	1	1	0	0	1	0	0	3	3	0	0	2	0	1
12	0	0	0	0	0	0	0	0	0	1	0	2	0	1	0	0	0	0	1	1	1	0	0	0	0
13	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	3	0	0	0	0
14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	3	0	0	0	0	0	0
15	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	M	0	5	1	0	0	0	0	0	0
16	0	0	0	0	0	0	0	0	0	0	0	6	1	0	0	0	1	0	0	0	0	0	0	0	0
17	2	1	2	3	0	2	2	2	0	0	0	0	3	0	1	2	1	5	2	0	1	2	1	0	1
18	0	1	1	0	0	1	0	0	0	1	2	0	3	2	1	0	4	2	0	0	0	0	0	0	1
19	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	4	1	0	0	0	0	0
20	2	3	3	2	3	3	6	2	2	2	2	3	2	1	4	3	1	3	7	3	3	3	2	0	3
21	0	0	0	0	0	0	0	0	0	0	0	2	0	1	0	0	2	1	0	0	0	0	0	1	0
22	3	4	4	2	4	3	2	2	1	2	2	1	2	4	3	7	5	6	9	6	5	5	5	3	4
23	3	3	3	2	2	1	2	3	0	0	0	1	1	2	3	1	3	2	4	6	3	2	2	3	2
24	2	1	1	1	1	1	1	0	0	0	0	1	2	3	1	0	2	5	3	3	3	2	2	2	2
25	8	5	2	3	1	0	2	0	0	1	2	0	0	0	0	0	1	5	3	5	4	4	2	0	2
26	3	3	2	1	5	3	2	3	3	3	2	2	2	1	4	4	3	3	3	4	3	2	4	0	3
27	0	0	0	0	0	0	0	0	2	3	0	0	0	0	0	0	2	1	0	0	0	0	0	0	0
28	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
29	0	0	0	1	0	0	0	0	0	0	0	0	0	1	1	0	0	0	1	0	0	0	0	1	0
30	3	4	1	0	0	4	4	0	0	0	0	1	7	0	4	3	0	2	3	1	1	1	0	2	2
31	5	0	2	1	0	0	2	1	0	0	0	1	1	2	0	0	2	2	4	1	0	1	3	0	1

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	1-HR	-	24-HR	-	4	2	100					0	ABOVE LIMIT	LEVEL
2	0	1	0	3	4	6	7	0	-	9	0	-	100				0			

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	16	16	6	15	19	17	12	13	15	12	14	17	11	11	10	9	15	19	17	11	9	15	11	10	13
2	11	13	8	13	8	5	17	10	5	4	13	5	4	5	9	3	13	20	26	30	22	16	11	12	12
3	8	M	11	11	9	9	14	10	7	6	7	7	5	4	4	3	5	6	7	8	8	4	9	7	7
4	10	7	3	8	7	5	7	9	8	9	6	4	8	16	4	3	6	17	11	10	25	13	13	4	9
5	3	5	3	2	5	2	7	22	42	68	43	19	12	25	19	6	6	12	8	5	7	6	3	7	14
6	7	4	7	4	6	6	7	6	6	4	5	4	3	2	3	3	2	4	10	11	9	11	7	9	6
7	8	9	10	4	12	7	6	9	9	6	7	5	7	3	4	3	3	5	8	9	5	5	5	6	6
8	6	6	16	9	10	22	19	12	16	8	4	10	8	13	13	7	7	12	11	10	17	16	10	4	11
9	5	7	12	15	17	22	15	20	15	13	7	8	12	6	3	4	6	4	8	10	13	11	8	19	11
10	14	4	11	11	5	8	3	1	2	3	2	6	15	4	6	6	3	5	5	6	5	3	4	10	6
11	7	11	7	15	4	24	15	6	5	7	3	4	10	6	5	5	4	6	6	5	5	6	5	6	7
12	7	6	21	6	23	9	11	14	5	4	4	7	3	2	3	4	9	11	10	13	8	10	7	5	8
13	6	0	3	3	1	6	4	14	5	1	4	6	4	7	11	4	4	4	6	8	7	5	4	2	5
14	1	1	3	1	0	2	3	3	4	4	3	1	0	0	0	0	0	1	2	5	6	1	2	1	2
15	1	0	0	1	3	1	1	2	2	2	0	3	0	0	0	M	13	13	14	14	14	13	15	14	5
16	13	12	12	15	13	12	12	12	13	12	12	14	14	12	15	13	14	16	15	15	17	17	14	19	14
17	16	M	14	12	14	15	16	19	16	18	18	14	13	15	15	15	14	14	13	16	15	16	20	18	15
18	17	16	16	14	15	12	15	18	15	15	17	14	16	17	16	13	20	12	13	16	15	17	15	18	16
19	18	19	24	21	19	15	14	17	19	23	19	16	15	17	16	15	17	16	14	15	13	14	15	7	17
20	4	6	5	4	5	4	10	2	2	4	2	2	3	1	2	2	2	2	2	6	4	10	6	3	4
21	2	5	11	5	4	5	3	3	5	2	4	2	2	2	2	3	6	7	8	6	3	4	3	4	4
22	4	4	5	5	2	3	6	4	3	3	3	2	2	3	3	1	4	6	6	14	11	10	5	6	5
23	5	6	8	18	15	12	12	7	5	5	10	17	9	6	3	3	8	11	11	10	14	16	11	10	
24	5	11	12	16	10	7	12	5	3	14	9	19	15	25	22	20	28	14	25	35	17	13	15	12	15
25	14	11	7	8	19	18	11	14	13	11	12	7	13	6	8	3	6	8	5	8	5	4	4	9	9
26	8	4	4	5	6	5	4	6	17	10	8	17	7	8	10	13	13	12	11	15	8	15	16	14	10
27	13	7	10	8	9	16	7	11	11	14	9	5	8	9	11	8	5	7	5	6	3	3	3	3	8
28	1	2	2	2	2	2	2	2	8	3	5	8	7	4	3	6	7	7	8	6	12	12	6	4	5
29	7	4	1	4	7	5	6	6	4	3	7	8	3	9	13	4	7	6	5	11	4	3	2	2	5
30	2	1	1	0	1	5	2	3	4	3	9	9	4	7	6	5	10	15	16	9	15	6	5	3	6
31	2	M	5	1	4	2	6	6	9	10	6	7	3	14	9	5	14	10	22	17	12	13	20	23	10

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE			STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	-	PERCENT	ABOVE LIMIT	LEVEL					99	0	
MEAN	MEDIAN	MEAN	50	90	95	98	99	0	-	68	2	-	17	2					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	11	11	11	10	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
2	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	12	11
3	11	11	11	11	11	11	11	10	10	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
4	11	11	11	11	11	11	11	10	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	13
5	11	11	10	11	11	11	11	11	12	12	11	11	11	11	11	11	11	11	11	11	10	11	11	13	11
6	11	11	11	11	11	11	11	11	11	13	12	11	12	11	11	11	11	11	11	11	11	11	11	11	11
7	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	10	11	11	11	11	11	11	11	13	11
8	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
9	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	10	11	11	11	11	11	11	11	11	11
10	11	11	11	11	11	11	11	11	11	11	11	11	12	11	11	11	11	11	11	11	11	11	11	11	11
11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
12	11	11	11	11	11	11	11	11	11	11	11	11	11	11	10	11	M	9	10	10	10	10	10	10	9
13	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
14	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	9	10
15	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
16	10	10	10	10	10	10	10	9	10	10	9	10	10	10	10	10	10	10	10	10	10	10	10	10	9
17	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	10	10	10	10	10	10	11	10	10
18	10	10	10	10	10	10	10	10	10	10	10	10	11	10	10	10	11	11	11	10	10	10	10	10	10
19	10	10	10	10	10	10	10	10	10	11	11	11	11	10	11	10	10	10	10	10	10	10	10	10	10
20	10	10	10	10	10	10	10	10	10	9	10	10	10	10	10	10	10	10	10	10	10	10	10	9	10
21	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	11	10
22	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	9	10	10	10	10	10	10	10	11	9
23	10	10	10	10	10	10	11	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	10
24	10	10	10	10	10	10	10	11	10	10	10	10	10	11	11	10	11	11	10	10	10	10	11	11	10
25	10	10	10	10	10	10	10	10	10	11	11	11	10	10	11	11	11	11	11	10	11	10	11	11	10
26	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	11	11	10	10	10	10	10	10	10
27	10	10	10	10	10	10	10	10	10	10	10	10	11	10	11	10	10	11	10	10	11	10	10	11	10
28	10	10	11	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
29	10	10	11	10	10	10	10	10	10	10	11	10	10	10	10	10	11	11	10	10	10	10	10	10	10
30	10	11	11	10	10	10	10	10	10	10	11	10	10	10	11	11	10	10	10	10	10	10	10	10	10
31	10	10	10	10	10	10	10	10	10	10	10	11	10	10	10	11	11	11	10	10	10	10	10	10	10

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	100	ABOVE LIMIT	LEVEL	100	100				1	100	0
MEAN	MEDIAN	MEAN	50	90	95	98	99	1-HR	24-HR	100	ABOVE LIMIT	LEVEL	1	100	0	0	0	0	0
10	10	10	10	11	11	11	12	9	-	13	10	-	11	1	100	0	0	0	0

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	5	4	4	5	5	4	6	5	6	4	6	8	11	8	5	6	5	6	6	6	5	4	6	5	6
2	5	3	3	4	5	4	8	7	7	6	4	5	4	3	5	6	8	9	10	11	9	8	5	8	6
3	11	M	6	6	2	3	5	5	7	7	7	7	7	7	6	6	6	6	4	3	3	3	3	2	5
4	4	2	1	1	2	2	3	6	9	12	11	7	12	14	9	3	9	7	4	6	7	7	8	6	6
5	2	1	1	4	4	3	5	11	13	10	10	12	7	10	8	10	14	8	11	6	4	3	3	3	7
6	3	2	2	1	2	3	6	6	8	8	10	13	6	5	3	3	6	7	6	6	4	4	4	4	5
7	2	2	3	1	2	3	3	8	7	6	6	5	11	4	4	3	4	6	9	11	7	6	6	7	5
8	7	8	4	3	2	6	8	7	6	7	8	9	6	6	8	5	6	6	7	6	7	8	9	12	7
9	9	9	8	6	8	7	9	6	10	7	6	6	6	5	5	4	5	3	7	10	7	7	9	12	7
10	10	3	7	3	3	1	5	6	9	7	6	7	8	7	6	3	4	5	7	8	11	7	12	9	6
11	7	6	5	2	2	5	8	8	8	9	6	5	4	6	8	10	6	6	7	6	10	12	6	6	7
12	14	6	3	5	6	6	7	8	8	13	11	10	9	9	6	M	4	9	8	9	11	10	8	6	8
13	6	5	2	4	3	4	5	4	10	6	4	10	6	6	10	12	7	6	9	10	9	4	4	3	6
14	2	1	1	1	1	1	2	1	2	2	2	2	1	1	1	1	1	1	1	2	3	2	1	1	1
15	1	1	0	0	0	0	1	1	3	5	4	5	4	5	5	5	5	5	3	2	2	1	1	1	3
16	1	0	0	1	0	0	1	3	3	4	4	5	4	4	5	5	5	5	4	2	2	3	2	1	3
17	1	M	1	0	0	0	3	4	2	6	6	8	7	6	7	8	8	7	5	3	2	1	1	1	4
18	0	0	1	1	1	1	1	4	7	8	11	19	12	11	10	13	14	13	11	10	8	6	4	3	7
19	1	1	2	2	1	1	4	4	5	8	9	7	11	12	10	8	8	7	3	2	2	1	1	2	5
20	1	0	0	0	1	1	2	1	3	4	4	5	3	5	6	5	4	3	2	2	1	1	1	2	
21	1	0	1	0	0	1	1	1	1	0	1	1	1	1	1	1	1	1	2	1	1	1	1	1	
22	1	0	1	1	0	0	2	2	4	5	6	5	5	5	5	5	7	8	9	4	3	4	3	5	4
23	2	1	7	5	3	3	7	5	3	11	9	7	6	4	3	2	4	5	5	5	5	5	8	9	5
24	4	3	2	3	5	4	6	6	8	8	10	10	17	16	14	12	17	11	11	11	7	5	5	7	8
25	7	4	4	3	5	4	5	10	10	12	11	10	10	10	7	7	7	8	7	7	6	5	5	8	7
26	5	2	3	2	3	3	4	5	10	11	10	9	6	5	5	6	7	14	9	10	6	6	6	4	6
27	4	3	4	6	4	6	7	6	6	12	16	11	5	8	7	9	14	10	5	4	4	2	2	2	7
28	1	0	0	0	0	1	2	2	3	2	3	2	4	3	2	4	2	2	2	2	2	3	3	2	2
29	1	1	0	1	1	1	2	2	5	6	6	7	7	8	11	10	7	5	3	3	2	2	2	2	4
30	1	1	0	0	0	1	2	5	6	9	9	8	7	5	6	10	11	14	14	14	8	7	6	4	2
31	1	M	6	2	3	2	4	6	7	10	8	6	7	12	10	6	6	7	7	9	7	8	10	9	7

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	ABOVE	LIMIT				0	0	0
4	5	5	10	11	13	14	0	-	19	1	-	8	2	99					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : POK FU LAM
POLLUTANT : SULPHUR DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	2	2	2	2	2	2	3	3	4	3	7	6	3	2	1	1	2	2	1	2	2	3	2	18	3
2	5	3	3	3	2	3	3	4	4	5	5	4	3	3	2	2	1	1	3	2	3	3	2	13	3
3	4	2	2	3	3	3	3	4	4	8	4	5	2	2	3	1	1	2	2	2	2	2	2	3	3
4	3	3	3	4	2	2	3	3	5	10	6	4	2	0	1	4	3	2	2	2	2	2	4	4	3
5	2	3	3	2	5	3	1	4	6	5	9	6	2	1	1	1	2	2	2	2	3	2	3	4	3
6	3	2	2	3	3	4	3	3	5	8	8	4	4	4	1	1	1	2	2	2	2	2	3	3	3
7	3	3	3	3	3	3	3	4	6	19	25	23	22	20	17	15	13	12	12	11	12	13	14	14	11
8	14	12	12	11	10	9	7	9	15	27	28	29	33	34	34	32	29	27	25	22	20	19	19	18	21
9	17	19	18	16	14	13	12	13	18	39	45	42	38	37	36	33	30	29	26	24	22	23	24	25	26
10	25	23	22	23	20	15	16	13	18	36	42	42	40	37	34	32	30	28	26	24	22	21	19	17	26
11	15	13	11	11	12	7	3	3	3	6	21	26	23	22	20	18	11	12	10	8	6	5	2	3	11
12	1	2	2	3	2	3	3	3	4	2	5	4	1	0	4	5	M	6	1	2	3	2	2	32	4
13	7	4	3	2	3	3	2	2	5	8	2	2	4	3	1	1	1	2	2	2	3	2	2	25	4
14	5	3	3	3	2	2	3	4	5	8	5	1	2	2	1	2	1	0	2	2	4	2	3	21	4
15	7	3	5	2	4	2	4	2	2	4	5	6	3	2	2	2	2	2	1	2	2	2	2	32	4
16	8	5	4	3	4	6	3	3	4	8	3	1	1	5	4	2	2	1	2	2	2	4	4	22	4
17	8	3	7	3	1	3	4	5	4	6	5	3	1	1	2	2	2	1	3	4	3	3	4	33	5
18	9	3	5	5	1	4	3	3	3	6	1	2	2	4	3	3	4	5	2	3	4	3	2	27	4
19	12	6	5	2	5	6	4	3	4	1	3	3	5	6	4	4	3	2	1	2	4	3	3	30	5
20	10	6	6	3	6	2	3	4	3	6	2	4	2	4	3	3	2	1	2	2	3	3	3	35	5
21	10	6	5	5	2	4	2	2	4	8	4	1	2	2	3	3	3	1	2	3	3	3	4	30	5
22	11	7	4	4	4	3	4	2	7	9	4	2	2	2	2	2	2	2	1	2	3	3	4	41	5
23	11	6	4	4	4	4	3	4	4	10	6	3	1	2	1	2	2	2	1	3	3	3	3	35	5
24	9	5	2	4	3	3	3	3	3	5	6	4	3	5	1	2	2	2	2	2	3	3	3	25	4
25	5	3	3	3	3	3	5	3	5	8	6	3	1	2	1	2	3	3	2	2	2	3	3	36	5
26	9	4	3	3	3	3	3	3	3	3	3	4	4	4	4	3	4	3	3	3	3	4	4	14	4
27	5	3	3	3	3	3	3	3	4	4	3	4	3	3	4	4	2	5	3	4	4	4	3	19	4
28	6	5	3	3	4	4	3	2	2	3	2	4	4	3	3	3	3	3	4	4	4	4	2	25	4
29	12	5	6	3	3	2	2	2	3	4	4	3	2	4	4	4	3	3	3	4	2	4	2	44	5
30	13	8	6	5	4	5	4	2	3	5	4	4	0	4	2	3	4	3	3	4	3	2	4	50	6
31	12	9	7	6	3	2	4	4	3	3	1	4	4	3	3	2	3	3	3	3	2	5	5	16	5

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	ABOVE	LIMIT				0	0	0
MEAN	MEDIAN	MEAN	50	90	95	98	99	0	-	50	3	-	26	2	100				

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : POK FU LAM
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	4	3	4	4	3	3	3	3	2	5	6	5	4	6	7	3	10	4	3	2	2	4	2	4	
2	2	1	2	2	3	1	2	3	4	4	8	5	4	5	9	10	5	5	7	6	3	3	4	6	4
3	6	4	3	5	1	2	4	2	2	3	6	5	5	5	3	2	1	1	2	1	1	0	0	0	3
4	1	1	0	1	1	1	2	6	5	18	21	21	18	13	6	2	4	5	3	4	4	4	4	4	6
5	0	0	0	6	13	7	14	12	10	11	11	15	7	10	6	12	19	7	4	2	1	1	1	1	7
6	1	1	1	1	1	2	3	7	9	10	18	18	6	3	4	4	6	5	3	2	2	2	1	1	5
7	0	M	1	0	2	2	5	6	5	10	7	6	6	3	4	3	5	5	4	6	4	2	3	2	4
8	3	3	2	1	0	2	4	5	9	10	9	10	6	4	9	8	10	6	4	4	2	3	6	7	5
9	5	7	4	2	3	3	6	7	8	6	9	7	9	9	6	5	6	7	4	6	3	3	4	6	6
10	4	1	4	3	2	2	3	3	2	12	8	12	10	6	5	4	5	2	4	4	5	6	6	5	5
11	5	4	2	2	0	2	3	6	11	10	12	6	4	12	14	8	3	2	4	3	5	8	4	5	6
12	9	4	1	2	6	2	4	4	4	3	4	5	4	4	8	11	M	13	4	5	5	4	3	2	5
13	3	3	0	1	1	2	2	0	7	11	5	9	5	7	11	9	6	2	4	4	4	2	2	0	4
14	0	0	0	0	1	2	4	1	2	5	4	3	3	2	2	1	1	1	0	1	1	2	1	0	2
15	2	2	1	1	0	0	1	1	0	2	8	5	4	2	5	6	3	2	1	0	0	0	0	0	2
16	0	0	0	0	3	2	1	2	3	6	4	1	2	2	2	2	1	1	1	1	2	2	2	2	2
17	0	0	0	0	0	2	4	2	2	5	5	5	4	5	6	3	2	2	1	1	0	0	0	1	2
18	1	0	0	1	0	0	0	1	1	3	1	1	2	6	6	6	14	13	8	5	15	10	2	1	4
19	2	1	2	1	2	3	2	3	14	6	7	2	7	9	6	8	2	1	1	0	0	0	1	2	3
20	0	0	0	0	0	0	3	0	0	0	1	1	0	0	0	0	0	0	1	1	1	1	1	0	0
21	0	M	1	0	0	0	1	0	0	0	1	1	0	0	1	0	1	1	1	0	0	1	0	0	0
22	0	0	0	0	0	0	2	2	0	2	3	3	4	2	0	1	1	2	3	0	1	1	1	2	1
23	1	0	4	3	1	1	2	4	7	10	7	4	3	2	1	0	1	3	3	5	3	5	4	3	3
24	2	2	1	4	4	3	5	5	8	5	7	6	6	11	13	8	9	6	5	5	2	3	4	5	5
25	7	4	3	2	4	0	0	0	0	1	1	11	17	14	11	11	12	12	10	10	9	6	7	12	7
26	10	4	7	3	4	5	3	5	8	10	8	6	9	11	14	12	15	11	3	3	4	5	3	3	7
27	3	2	3	1	3	3	5	4	7	6	7	6	6	5	5	7	5	4	1	1	1	1	0	4	
28	0	1	0	0	0	2	2	0	2	1	2	4	3	2	2	4	2	1	1	1	1	2	1	0	1
29	1	0	0	0	0	1	1	2	1	1	1	1	4	4	9	6	3	3	2	2	2	3	5	2	2
30	2	2	0	0	0	1	1	3	2	9	6	6	4	4	5	8	7	11	16	7	9	3	2	0	5
31	0	2	9	2	2	0	4	5	7	12	9	4	4	9	7	4	4	4	6	5	3	4	6	5	5

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	7	100	PERCENT	ABOVE LIMIT	LEVEL				0		
3	3	4	3	9	11	14	17	0	-	21	0	-	7	2					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : AP LEI CHAU
POLLUTANT : SULPHUR DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	3	3	3	3	3	3	3	3	3	3	3	4	3	4	4	3	3	4	4	3	3	4	4	3	
2	3	4	3	3	4	3	3	3	3	3	3	3	3	3	3	4	4	4	4	4	3	4	4	3	
3	6	4	5	4	3	4	4	4	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	4	
4	3	3	3	3	3	3	3	3	3	4	4	4	5	3	4	3	4	4	4	4	4	4	4	4	
5	3	4	4	4	4	4	4	4	4	6	5	7	6	6	6	6	6	6	4	4	3	3	3	5	
6	3	3	3	3	4	3	4	4	4	4	7	4	3	3	3	4	3	3	3	3	3	3	3	3	
7	3	3	3	3	3	3	3	5	5	5	6	4	4	5	4	3	4	4	4	3	3	4	4	4	
8	4	5	4	4	4	4	4	4	4	6	4	5	5	4	5	4	5	4	4	4	4	4	4	4	
9	4	4	4	4	4	4	4	4	4	5	4	5	5	5	4	5	4	4	3	4	4	4	4	6	
10	3	4	4	3	3	3	3	3	4	4	5	6	5	5	4	3	3	3	3	4	3	3	4	4	
11	3	4	4	3	3	4	3	4	3	5	4	3	3	4	4	3	4	3	3	3	4	4	3	4	
12	4	4	4	4	3	3	3	3	3	3	3	3	3	3	3	4	4	4	4	3	3	3	3	3	
13	3	3	3	3	4	3	3	3	4	4	3	4	4	3	6	4	4	3	3	3	3	3	3	3	
14	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
15	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
16	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
17	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	2	3	3	3	3	3	
18	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
19	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	2	3	3	3	3	3	3	
20	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	2	3	3	3	3	3	
21	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
22	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
23	3	3	3	3	3	3	3	3	4	4	4	5	4	4	4	4	3	4	4	3	3	3	4	4	
24	3	3	3	3	3	3	3	4	3	3	4	4	4	4	4	4	4	4	3	4	4	3	3	4	
25	3	3	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	6	5	4	6	5	4	5	
26	6	4	4	4	5	4	4	6	5	4	4	4	4	4	4	4	4	4	4	3	3	3	3	4	
27	3	3	3	4	4	4	3	3	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
28	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
29	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
30	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	
31	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	3	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES						RANGE			STN GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	2	1-HR	7	3				100	ABOVE LIMIT	LEVEL
3	3	3	4	5	6	6	2	-	7	3	-	5	1	0		

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : AP LEI CHAU
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	7	4	3	5	7	6	5	8	6	5	8	11	8	10	8	9	7	6	9	7	7	5	11	9	7	
2	4	6	3	7	10	4	7	7	4	5	3	5	4	5	7	13	13	14	17	17	17	13	7	17	9	
3	30	15	19	11	7	10	10	7	4	4	3	4	3	4	2	2	3	4	3	4	5	3	5	5	7	
4	7	6	2	7	5	6	6	11	14	9	8	10	25	16	12	8	13	15	10	10	11	15	12	8	10	
5	3	8	3	10	17	18	24	29	34	26	26	18	16	14	14	15	16	9	8	4	5	5	4	6	14	
6	6	5	7	5	7	11	13	6	8	6	16	9	4	5	3	3	3	5	13	10	9	8	6	7	7	
7	5	6	7	3	10	8	7	20	14	10	8	8	7	10	6	5	7	8	18	21	7	7	10	12	9	
8	14	12	6	5	9	13	12	10	16	14	23	18	9	14	13	15	12	12	11	24	12	17	18	8	13	
9	19	M	13	12	18	11	19	12	16	16	17	11	12	10	12	12	9	7	10	18	12	10	20	34	14	
10	7	9	13	10	10	10	16	13	10	9	14	16	17	10	8	9	8	11	10	21	12	11	13	15	12	
11	9	15	12	7	11	18	11	16	8	15	9	8	6	25	16	8	8	10	8	13	13	14	10	10	12	
12	21	14	14	13	14	7	12	7	5	9	6	5	7	7	12	23	12	18	13	17	13	10	2	5	11	
13	15	3	3	5	13	13	7	5	12	8	5	5	11	6	16	12	12	7	10	11	8	7	7	3	9	
14	2	2	4	3	3	4	4	3	4	2	3	3	4	3	3	3	3	3	4	6	7	5	3	3	4	
15	5	3	3	3	4	4	4	4	3	2	5	4	2	2	5	4	2	3	2	2	2	2	2	2	3	
16	2	1	1	4	2	3	7	10	4	3	2	3	6	4	3	3	4	2	4	3	3	3	3	5	4	
17	6	3	2	1	2	11	10	4	4	5	5	1	2	3	3	2	2	2	2	2	3	4	6	5	4	
18	4	4	4	3	3	2	3	3	2	2	3	2	2	9	9	15	9	19	18	7	5	8	8	6	7	
19	3	5	9	6	8	6	6	9	15	12	9	9	3	9	4	3	3	4	3	3	2	2	2	4	6	
20	2	3	3	3	4	3	5	2	2	3	3	2	2	1	2	2	2	2	3	3	3	3	5	3	2	3
21	1	3	7	3	2	3	2	2	3	2	2	3	2	3	3	2	2	2	4	4	3	2	2	3	3	
22	2	2	4	5	2	3	4	2	2	2	3	1	1	1	2	2	3	7	4	5	7	8	5	9	4	
23	3	M	28	21	21	7	12	6	10	13	20	26	19	21	17	13	17	18	11	12	17	23	15	27	16	
24	11	14	10	7	14	11	13	9	12	17	19	21	18	31	24	38	42	31	40	37	17	13	15	15	20	
25	11	7	7	6	14	12	11	14	17	18	21	22	31	19	29	30	26	42	41	26	31	28	21	31	21	
26	32	18	23	23	30	15	13	36	26	25	18	16	12	13	11	10	11	9	7	9	10	15	13	7	17	
27	6	6	8	9	10	12	12	10	12	9	15	13	12	10	8	10	12	9	5	4	4	5	4	9		
28	6	4	4	4	5	6	11	9	8	5	8	M	8	11	8	10	7	6	6	6	6	7	7	3	7	
29	5	4	3	4	4	5	4	4	3	3	4	5	12	11	12	5	5	6	6	8	5	6	6	5	6	
30	6	4	3	2	3	8	7	4	4	6	6	9	8	11	7	11	15	17	14	12	16	14	8	5	8	
31	5	9	10	9	8	5	10	8	12	14	12	18	8	16	11	6	8	7	8	10	13	16	15	21	11	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1	-	42	3	21	2	100				ABOVE LIMIT	LEVEL	
MEAN	MEDIAN	MEAN	50	90	95	98	99	1	-	42	3	-	21	2	100	0			
7	7	9	7	18	23	30	34	1	-	42	3	-	21	2	100	0			

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHEUNG CHAU
POLLUTANT : SULPHUR DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN		
1	0	0	0	0	0	0	0	0	0	0	0	7	10	0	0	0	0	1	0	0	0	0	0	7	1		
2	0	0	0	0	0	0	0	0	0	0	0	2	1	0	3	7	6	12	0	0	0	0	0	7	2		
3	0	0	0	0	0	0	0	0	1	2	1	1	0	0	1	8	8	1	0	0	0	0	1	10	1		
4	0	0	0	0	0	0	0	0	0	1	2	0	0	0	4	3	6	1	12	5	0	0	0	0	13	2	
5	1	0	0	0	0	0	0	0	1	3	4	1	0	2	15	34	42	32	4	0	0	0	0	0	12	6	
6	0	0	0	0	0	0	0	0	1	4	3	1	3	10	30	53	62	46	16	8	0	0	1	1	11	10	
7	2	1	1	0	1	1	1	1	3	7	6	1	1	4	22	26	31	14	6	0	0	0	0	1	10	6	
8	2	2	2	3	3	2	3	4	8	17	25	14	5	6	15	22	41	24	6	6	1	1	0	18	10		
9	3	2	1	1	1	2	1	2	6	10	15	23	7	2	12	29	41	40	19	5	2	2	2	20	10		
10	6	3	3	5	7	6	6	7	10	16	18	14	10	8	23	40	57	50	20	12	10	10	10	2	15		
11	0	0	0	0	0	0	0	0	0	0	0	0	0	0	M	M	1	2	4	3	3	3	4	55	9	4	
12	6	5	4	4	4	4	4	4	4	3	4	4	3	4	4	4	3	4	3	3	3	3	3	6	4		
13	4	4	3	3	3	3	3	3	3	4	4	3	4	3	3	3	3	3	3	3	3	3	3	3	4	3	
14	4	3	3	3	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	3	3	3	3	5	3	
15	3	3	3	3	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	2	3	3	3	5	3	
16	3	3	3	3	3	3	2	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	5	3	
17	2	3	3	3	3	3	3	2	2	3	2	2	2	2	3	3	3	3	3	2	2	2	2	47	3	4	
18	3	3	3	3	3	3	3	3	3	3	3	2	M	M	M	M	M	M	M	M	M	M	M	M	M		
19	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	3	3	3	3	3	2	3	2	2	6		
20	3	3	3	3	3	3	3	3	3	3	3	3	3	3	2	3	3	3	3	2	3	2	3	3	5	3	
21	3	3	3	3	3	3	2	3	3	2	2	2	2	2	2	2	2	2	3	3	2	2	2	3	5	3	
22	3	3	3	3	3	3	2	2	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	4	2	
23	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2	2	2	3	3	2	2	2	2	2	5	3	
24	3	3	3	3	3	3	2	3	2	2	3	3	2	2	2	2	2	2	2	2	2	2	2	2	5	2	
25	3	3	3	3	3	3	3	3	3	3	3	3	3	2	2	2	2	2	2	2	2	2	2	3	4	3	
26	3	3	3	3	2	2	2	2	2	3	2	2	2	3	3	2	2	2	2	2	2	2	2	2	9	3	
27	4	3	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	5	2	
28	3	3	2	2	2	2	2	2	2	2	2	3	2	2	2	2	2	2	2	2	2	2	2	2	6	2	
29	3	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	5	2	
30	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	5	2	
31	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	3	5	2

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	0	-	62	1	-	15	2				97	0	ABOVE LIMIT
3	3	4	3	6	14	31	42	0	-	62	1	-	15	2	97	0	0	0	0

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHEUNG CHAU
POLLUTANT : NITROGEN DIOXIDE

MONTH: JULY

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	10	8	7	5	4	5	7	3	3	7	6	3	4	2	2	1	4	3	5	7	2	6	3	2	5
2	4	2	5	4	2	6	2	3	2	2	1	3	3	3	3	5	5	8	20	11	12	10	4	5	
3	3	M	6	11	5	14	11	9	7	4	3	6	5	5	3	4	4	4	8	6	5	7	7	12	6
4	7	5	4	3	8	6	6	4	12	14	18	12	6	3	7	3	2	1	5	12	15	23	12	34	9
5	39	19	9	37	32	34	42	34	26	10	5	5	3	2	3	3	3	4	8	11	10	13	15	12	16
6	16	10	11	13	16	10	10	15	19	11	13	6	3	5	9	8	4	7	4	4	12	9	8	10	10
7	16	22	11	6	4	13	11	13	13	6	3	2	1	1	1	2	3	1	3	5	7	7	9	5	7
8	5	3	7	3	4	7	17	18	11	15	7	2	3	4	2	3	1	2	6	7	14	17	24	8	8
9	6	11	10	8	14	9	14	12	7	11	2	3	2	3	2	1	1	3	2	5	5	4	10	7	6
10	4	7	8	2	11	24	26	33	28	27	13	5	8	4	2	2	2	2	1	4	3	3	4	5	10
11	4	4	2	3	6	9	14	3	2	2	1	1	M	M	4	1	2	2	2	2	2	3	2	3	
12	4	2	5	5	7	5	5	3	2	3	4	6	4	1	2	2	2	2	2	2	3	3	3	2	3
13	3	3	2	3	3	3	3	1	1	2	3	1	1	2	2	2	3	1	1	2	3	3	2	3	
14	2	4	2	3	15	8	5	6	4	3	2	2	3	3	3	3	6	12	6	13	24	26	8	13	7
15	8	6	10	8	15	8	8	4	6	8	10	5	8	4	2	3	8	4	4	4	7	5	4	3	6
16	9	5	2	2	5	7	13	18	21	11	5	9	26	16	5	5	6	6	6	4	6	4	2	5	8
17	18	M	10	4	12	4	4	2	6	8	6	6	5	5	3	2	4	4	5	9	7	6	10	6	
18	15	14	9	7	12	8	12	2	4	9	6	2	18	M	M	M	M	M	M	M	M	M	M	M	
19	M	M	M	M	M	M	M	M	M	M	M	M	14	15	16	9	13	6	7	5	7	3	7		
20	7	4	7	11	5	5	3	5	2	2	4	3	2	2	1	3	1	1	2	4	4	4	6	6	4
21	7	5	6	8	7	6	8	4	7	4	2	4	6	3	4	2	3	4	7	7	7	4	7	6	5
22	3	3	4	10	9	4	5	6	2	3	5	3	4	4	5	3	9	9	2	17	29	12	16	2	7
23	3	4	4	7	12	33	30	22	15	9	4	2	2	3	3	4	5	4	8	8	14	12	8	8	9
24	10	5	4	6	7	13	13	5	6	15	17	19	9	16	8	8	18	23	14	9	4	5	7	6	10
25	6	3	5	6	6	5	11	10	8	8	6	7	6	6	6	7	6	6	5	5	4	4	2	3	6
26	3	2	3	2	2	2	2	4	4	7	12	7	7	8	7	4	6	4	5	5	12	8	13	5	6
27	6	5	13	5	4	5	7	13	8	4	6	4	3	3	4	6	7	6	3	5	7	5	2	6	
28	4	3	4	7	3	6	17	11	3	11	30	12	4	8	5	13	6	6	13	16	10	3	5	4	9
29	5	10	14	11	7	7	18	9	11	11	9	8	4	2	3	4	10	13	11	7	10	11	8	7	9
30	8	17	18	5	7	9	6	4	8	8	12	2	4	4	4	5	5	7	6	5	9	11	10	10	8
31	20	M	4	13	11	15	32	20	3	3	4	11	15	5	11	9	3	6	7	7	10	8	8	7	10

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1	-	42	2	-	16	2				96	0	ABOVE LIMIT
5	5	7	14	18	27	33	1	-	42	2	-	16	2						

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : VICTORIA PEAK
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	2	2	2	2	2	1	2	2	2	2	2	2	2	2	2	2	3	2	2	2	2	2	2	3	2
2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	3	2
3	2	2	2	2	2	2	2	2	2	2	2	2	2	3	3	4	3	3	3	2	2	2	3	3	2
4	2	1	2	2	2	2	2	3	4	3	4	4	4	5	5	5	5	3	3	3	3	3	3	3	3
5	2	2	2	3	3	3	3	3	4	4	4	4	5	6	6	6	5	3	4	6	7	5	4	6	4
6	10	6	9	7	4	3	3	3	4	4	4	5	5	6	5	2	5	6	4	5	5	5	4	4	5
7	4	4	4	4	4	4	4	4	4	4	4	5	5	6	7	7	6	5	6	5	5	4	5	4	5
8	4	4	4	4	4	4	4	4	4	4	4	4	5	5	6	5	6	7	7	7	8	6	4	5	5
9	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	6	5	5	4	4	4	4	4	5	4
10	4	4	4	4	4	4	4	4	4	4	4	5	4	4	4	5	5	5	5	5	5	5	5	4	4
11	4	4	4	4	4	4	4	4	4	4	5	5	5	4	5	5	5	5	5	5	5	5	5	5	5
12	5	5	5	5	4	5	5	4	4	4	4	5	5	5	8	20	13	7	5	5	5	5	5	6	6
13	6	6	7	6	6	5	5	5	5	5	5	5	6	6	10	5	6	7	6	5	6	6	6	6	6
14	6	5	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	7	6	6	6	6	6	6
15	6	6	6	6	6	6	6	7	7	7	6	7	6	6	6	7	7	7	7	7	7	7	7	7	7
16	7	7	7	7	7	7	7	8	8	8	8	8	7	7	7	7	7	6	7	7	7	7	8	9	7
17	7	7	7	7	7	7	7	7	7	7	7	7	7	7	8	8	8	8	8	8	8	7	8	8	7
18	8	8	8	8	8	8	8	8	7	7	8	8	8	8	8	8	8	8	8	8	8	8	10	9	8
19	8	8	8	8	8	8	8	8	8	8	8	8	8	8	8	9	9	9	9	8	8	8	19	10	9
20	9	9	9	9	9	8	8	8	9	8	9	9	9	8	9	9	8	9	9	9	9	9	9	9	9
21	8	8	8	8	8	9	8	9	9	9	8	8	9	9	9	9	9	9	9	9	9	9	9	9	9
22	9	9	9	9	9	9	9	8	8	9	9	9	10	10	12	14	10	10	1	0	0	0	0	0	7
23	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
24	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
25	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
26	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
27	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0
28	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	0	0	0	0	0	0	0
29	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	2	2	1	0	0	0	0	0	0	0
30	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	1	2	0	0	0	0	0	0	0
31	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	10	0	-	20	0	-	9				100	PERCENT	ABOVE LIMIT
5	4	4	4	8	9	9	10	0	-	20	0	-	9	2		0			

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : VICTORIA PEAK
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	2	0	0	1	1	1	1	2	1	3	1	1	1	1	2	5	6	5	3	5	3	4	0	2		
2	1	0	1	0	0	3	2	2	3	2	2	1	1	1	1	1	6	9	5	2	1	2	2	1	2	
3	1	0	0	2	1	1	1	0	1	1	1	1	0	1	0	2	2	10	13	4	3	10	14	1	3	
4	2	4	2	2	0	0	4	5	7	3	2	6	3	2	2	4	5	5	9	6	6	3	1	4		
5	0	0	0	0	1	6	5	7	3	4	11	13	9	18	8	10	17	23	24	44	32	11	11	22	12	
6	45	12	46	27	2	0	2	2	7	9	16	21	19	14	4	10	23	34	49	52	36	9	4	4	19	
7	6	1	4	11	4	2	2	1	2	1	2	3	3	4	4	3	19	17	9	4	3	7	4	2	5	
8	2	1	1	1	1	2	1	3	1	3	1	2	2	2	2	2	5	14	16	14	19	7	1	1	4	
9	1	1	1	1	2	0	1	0	1	1	0	1	1	2	3	4	8	11	4	5	5	5	1	2	3	
10	2	1	1	2	1	1	3	3	2	2	1	2	0	2	2	1	8	8	11	8	7	4	5	2	3	
11	0	0	0	0	0	0	0	0	0	0	0	1	8	3	4	6	12	8	13	3	2	9	4	1	3	
12	0	0	2	2	2	9	4	2	3	1	1	2	6	1	7	21	23	18	10	3	6	5	9	29	7	
13	23	13	13	9	3	3	3	5	1	1	1	1	1	4	19	5	10	17	14	2	10	10	3	3	7	
14	4	M	1	5	9	4	11	4	3	7	4	1	1	1	6	10	13	13	6	4	1	1	12	5		
15	16	5	1	0	0	10	10	9	6	5	5	10	8	6	3	9	13	7	7	7	14	28	5	8		
16	6	2	0	0	0	0	1	1	13	11	10	10	13	2	3	6	6	9	10	7	1	3	2	0	5	
17	1	1	1	1	0	1	1	2	3	1	1	1	2	1	10	11	9	12	10	3	7	5	4	1	4	
18	2	12	10	9	6	3	4	4	2	3	1	2	1	3	3	1	4	7	4	4	2	1	3	3	4	
19	2	2	2	1	2	1	2	5	4	2	2	3	13	5	2	3	3	5	7	10	3	10	9	5	4	
20	3	1	0	2	1	0	0	0	7	4	4	4	10	8	10	7	3	10	2	4	3	2	2	2	4	
21	3	5	0	6	6	4	1	6	11	8	3	3	1	0	3	6	5	3	1	1	4	1	0	1	3	
22	0	0	0	1	0	4	5	6	2	1	1	3	3	2	8	12	7	2	2	2	10	9	1	4	4	
23	6	1	0	3	1	0	0	0	1	0	1	1	1	1	4	6	6	15	14	12	6	8	8	10	4	
24	7	13	2	2	1	1	0	0	2	3	3	1	5	5	4	10	12	10	17	8	9	11	12	6	6	
25	8	4	4	2	2	1	1	1	1	1	1	1	5	4	5	3	4	8	6	9	7	8	8	7	10	5
26	4	3	4	4	6	6	7	3	2	2	4	6	5	5	6	8	9	16	4	6	5	4	6	6	5	
27	2	0	1	2	1	3	3	1	1	0	4	6	7	5	5	8	8	10	11	8	9	15	23	16	6	
28	7	2	1	0	0	0	0	2	3	13	11	10	6	8	8	6	5	13	13	6	2	7	8	16	6	
29	18	24	48	41	25	16	38	30	13	14	8	10	6	2	4	9	7	8	9	21	15	19	4	2	16	
30	1	0	1	0	1	0	1	0	1	4	2	3	4	2	3	3	2	2	1	0	1	0	0	1	1	
31	0	0	0	0	1	1	0	1	4	2	3	4	2	3	3	1	0	0	0	1	2	0	0	1	1	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	1	-	19	3	100				0	ABOVE LIMIT	LEVEL
MEAN	MEDIAN	MEAN	50	90	95	98	99	1-HR	52	1	-	19	3	100	0	0	0	0	

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	M	0	0	1	2	0	1	1	0	0
2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	7	8	9	4	4	2	0	2
3	1	0	0	0	0	0	1	0	0	0	0	0	0	0	2	0	0	0	0	2	1	1	0	0	0
4	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	3	2
5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	4	2
6	5	3	2	2	4	1	3	1	0	0	2	1	3	2	14	2	0	8	5	3	3	1	1	0	0
7	1	0	0	0	0	1	1	0	0	0	0	0	0	1	0	1	2	1	3	3	0	2	3	3	1
8	11	13	8	8	4	4	4	4	4	4	2	2	4	3	4	5	3	1	6	8	3	1	2	1	5
9	2	1	1	0	3	3	0	2	1	0	0	0	0	0	3	0	1	2	7	3	2	4	1	0	2
10	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	3	9	7	3	7	7	3	3	5	4
11	6	6	3	4	2	3	4	4	1	1	3	1	10	8	3	1	4	5	6	7	7	4	3	1	1
12	3	1	1	2	1	0	0	0	0	2	0	0	0	0	0	0	0	2	2	0	3	1	0	1	1
13	3	3	6	2	2	5	3	1	0	0	0	2	1	1	1	4	3	1	3	3	2	1	1	2	2
14	2	2	2	2	5	3	2	7	2	3	1	0	1	2	3	4	5	4	6	3	3	4	1	2	1
15	1	2	1	1	1	2	0	0	0	0	0	2	0	1	1	2	0	1	0	0	0	1	2	5	0
16	0	0	0	0	0	2	2	0	1	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0
17	2	1	0	3	1	0	1	0	2	1	0	1	0	0	0	0	0	0	1	1	1	0	0	1	1
18	1	1	1	0	0	1	2	1	2	0	0	0	0	0	0	0	1	4	2	1	0	0	1	2	1
19	4	5	5	5	3	4	3	2	3	4	4	2	5	3	10	11	3	2	5	6	3	5	3	0	4
20	0	0	3	1	0	1	2	0	0	0	0	0	0	0	0	1	1	0	0	0	0	0	0	0	0
21	2	2	2	2	2	2	2	2	2	2	2	0	1	0	1	2	7	7	2	2	1	1	1	1	2
22	1	1	0	1	0	0	1	0	0	0	0	1	0	1	0	1	3	3	2	1	1	0	0	1	1
23	1	3	2	1	0	1	1	1	0	1	1	3	3	2	3	2	3	3	3	1	1	1	0	2	
24	0	1	0	1	0	0	2	2	0	0	0	0	1	1	1	0	0	0	1	2	3	2	0	0	1
25	0	0	4	1	0	0	2	0	0	0	0	0	0	0	1	1	1	1	1	0	0	0	0	0	1
26	2	6	3	1	3	4	1	1	0	1	0	1	1	1	6	1	1	0	3	3	0	0	0	1	0
27	1	0	1	2	2	2	2	1	0	0	0	0	0	1	1	0	2	1	0	4	2	0	1	1	1
28	3	0	2	3	0	0	0	2	0	0	0	0	0	1	0	0	0	1	3	3	0	1	0	0	1
29	4	1	3	5	3	3	3	1	0	0	1	1	0	1	0	2	1	1	4	3	1	1	1	1	2
30	1	1	4	1	2	0	0	0	0	1	0	0	0	0	2	1	0	3	3	2	1	1	1	0	1
31	0	0	1	1	1	1	2	5	1	0	0	0	1	1	2	2	0	0	1	0	3	1	2	0	1

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	0	-	14	0	-	24-HR	5	2	100	0	ABOVE LIMIT	LEVEL	
2	1	1	1	4	5	7	9	0	-	14	0	-	5	2	100	0	0	0	

- NOTES:
- FLAGS FOR INVALID DATA :
 - D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

MONTH: AUGUST

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	17	8	12	8	5	4	12	23	14	17	15	5	5	2	5	4	7	7	13	15	14	14	18	16	11
2	13	20	12	9	7	17	8	7	4	10	6	6	4	4	2	8	12	10	9	8	12	9	11	22	10
3	25	20	18	8	11	5	12	10	12	6	5	8	6	2	4	12	11	17	10	7	19	9	17	30	12
4	19	20	24	21	4	3	4	12	26	29	29	17	17	8	23	14	18	20	37	11	13	23	17	13	18
5	13	12	11	19	12	21	15	15	39	58	40	26	24	20	17	28	14	24	21	22	15	12	7	8	21
6	8	24	21	17	25	11	19	30	25	22	24	22	17	10	11	17	54	93	56	27	19	31	24	16	26
7	13	12	5	4	7	15	34	30	14	14	19	27	19	8	10	19	15	15	23	19	11	14	20	7	16
8	15	18	19	23	24	20	14	21	19	8	5	8	9	7	5	7	11	14	20	23	13	13	18	7	14
9	12	7	7	3	14	18	14	11	14	9	4	4	9	14	8	16	11	8	15	21	21	25	16	17	12
10	14	14	9	9	16	23	20	18	11	9	9	14	9	14	14	12	18	22	18	14	21	19	18	11	15
11	12	9	21	23	10	14	19	12	9	7	11	10	20	18	24	11	14	18	29	30	31	33	29	13	18
12	15	33	20	19	8	20	25	25	13	12	15	38	8	5	3	2	22	11	15	11	13	14	14	13	16
13	22	31	19	31	31	37	30	31	11	7	10	16	8	11	8	7	17	29	15	21	26	17	15	6	19
14	10	M	9	10	7	8	5	7	6	12	9	6	6	12	18	16	38	32	43	20	15	16	15	28	15
15	27	18	24	14	14	5	6	13	11	16	7	5	8	10	49	28	28	12	13	34	36	42	50	52	22
16	55	39	20	11	8	5	6	8	8	16	21	29	13	3	6	14	7	8	9	27	10	15	19	14	15
17	32	17	21	15	14	11	9	12	19	15	12	9	29	15	17	15	17	17	20	10	28	21	31	14	18
18	17	22	14	16	19	22	14	20	11	17	13	13	12	16	10	7	11	14	19	10	7	12	12	22	15
19	22	7	13	13	4	6	15	7	9	10	6	7	20	9	8	19	11	17	25	18	8	19	27	14	13
20	9	16	11	8	13	10	6	11	21	17	10	22	14	22	18	15	11	8	6	13	18	13	9	19	13
21	18	5	8	9	10	10	11	21	12	10	11	8	10	3	13	16	26	28	41	32	29	13	5	12	15
22	15	7	6	3	6	9	21	19	18	12	4	2	1	6	6	24	17	7	7	10	32	9	8	20	11
23	16	39	41	28	16	18	11	7	6	9	11	22	18	20	12	13	15	15	30	34	20	21	20	15	19
24	25	20	23	28	25	22	22	18	8	23	27	17	29	23	21	12	24	11	9	17	16	30	29	24	21
25	41	24	15	19	19	21	13	9	8	7	12	22	23	16	10	11	24	25	15	39	23	22	16	17	19
26	17	33	42	34	32	16	18	15	12	13	28	19	14	22	18	27	25	17	10	18	12	14	20	14	20
27	15	13	9	21	27	26	29	21	8	10	24	12	13	16	18	19	13	25	28	17	13	19	19	23	18
28	12	M	11	16	19	12	9	48	23	45	32	26	21	14	13	13	12	12	24	21	25	44	32	81	25
29	73	28	69	77	52	53	52	38	19	15	9	5	7	6	6	4	5	6	5	2	26	29	4	6	25
30	4	2	2	2	1	4	4	3	4	3	0	2	1	1	2	3	1	3	8	7	8	6	8	4	3
31	0	0	1	4	5	3	2	1	1	0	0	0	0	1	0	2	4	5	6	11	6	3	3	3	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE			STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	2	100	0	ABOVE LIMIT				100	0	ABOVE LIMIT
MEAN	MEDIAN	MEAN	14	29	34	48	55	0	-	93	3	-	26	2				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	10	10	10	10	10	11	10	10	10	10	10	10	10	10	10	11	11	10	10	10	10	11	11	11	10
2	10	11	10	10	10	10	10	10	10	11	11	10	10	11	10	10	10	11	11	10	11	10	10	10	10
3	10	10	10	10	11	10	10	10	10	10	10	10	11	10	10	10	11	10	10	10	11	10	11	11	10
4	10	10	10	11	11	10	10	10	11	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	10
5	10	10	10	10	10	10	10	10	11	11	11	10	10	10	10	10	11	10	10	10	11	10	10	11	10
6	10	10	10	10	10	10	10	10	11	11	11	11	11	11	10	10	11	11	11	11	10	10	11	11	10
7	10	10	10	10	10	10	10	10	11	11	11	11	11	10	10	10	11	11	10	10	10	10	10	10	10
8	9	10	10	10	10	10	10	10	10	10	10	10	10	10	10	11	10	10	10	10	10	10	10	10	10
9	10	10	10	10	10	11	10	10	11	11	11	11	11	11	10	11	11	11	10	10	10	11	10	10	10
10	10	10	11	11	10	10	10	10	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
11	10	10	10	11	11	11	11	10	11	11	11	11	10	10	10	11	10	10	10	11	11	10	11	11	11
12	10	11	11	11	10	10	11	11	10	10	11	11	11	11	11	15	11	11	11	11	12	11	12	12	11
13	12	12	12	11	12	12	11	11	12	11	11	12	11	12	12	12	11	11	11	11	11	11	11	13	12
14	12	12	12	12	11	12	11	12	12	12	11	11	12	12	12	11	12	12	11	11	12	12	12	12	12
15	12	12	11	11	11	12	12	12	11	12	11	12	11	11	11	11	11	12	11	11	12	12	12	12	12
16	11	11	11	11	11	11	11	11	13	13	12	12	12	11	11	11	10	11	11	11	11	11	11	11	11
17	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
18	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
19	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	12	11
20	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
21	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	12	12	11	12	12	11	11
22	11	11	11	11	11	11	11	11	11	12	11	12	11	11	12	11	11	11	11	11	11	11	11	11	11
23	11	11	11	11	11	11	11	11	11	11	11	11	11	12	12	11	12	11	11	11	11	11	11	11	11
24	11	11	11	11	11	11	11	11	11	12	11	12	12	11	12	12	11	12	12	12	10	11	11	12	11
25	11	11	11	11	10	11	11	12	11	11	12	12	11	12	12	11	11	12	11	12	11	12	11	11	11
26	11	11	11	12	11	11	11	11	12	12	11	12	12	12	12	12	11	11	11	12	11	11	11	11	11
27	11	11	11	11	11	11	11	12	11	11	12	13	12	12	12	12	12	12	12	12	12	11	11	11	12
28	11	11	11	11	11	11	11	12	12	12	13	13	13	12	12	12	12	12	11	11	11	11	11	12	12
29	12	12	12	11	11	11	11	13	13	12	12	12	12	12	12	12	12	11	11	11	11	11	11	11	12
30	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
31	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	VALID	DATA	NO. OF TIMES			
		50	90	95	98	99				1-HR	24-HR		100						ABOVE	LIMIT	LEVEL	0
11	11	11	11	12	12	12	13	9	-	15	10	-	12	1								

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	8	5	4	6	5	4	8	11	8	9	5	3	3	3	4	5	6	7	6	6	9	9	9	8	6
2	4	6	4	4	3	9	10	10	7	5	3	6	6	4	6	7	12	7	6	7	4	7	7	6	6
3	5	6	4	5	4	4	3	4	4	2	4	3	4	2	5	3	5	5	5	4	3	5	7	6	4
4	4	6	5	4	2	2	4	6	7	8	6	9	8	6	8	8	13	9	11	8	7	7	4	5	7
5	4	2	2	2	3	3	6	11	13	14	19	14	17	14	11	11	9	10	13	10	9	8	9	16	10
6	10	7	6	6	5	5	10	12	5	10	18	26	23	15	9	24	34	36	34	41	32	25	18	17	18
7	14	13	6	4	5	8	8	7	4	5	8	9	9	5	5	7	13	10	8	8	8	9	8	5	8
8	7	5	5	3	3	5	5	7	6	7	6	7	7	7	5	6	9	10	9	11	8	4	6	6	
9	6	4	5	3	3	4	4	3	4	5	4	5	7	5	6	6	7	4	5	6	7	9	6	8	5
10	8	5	5	5	4	5	9	9	9	8	6	5	5	9	7	5	7	7	11	10	10	8	5	7	7
11	3	3	5	2	3	4	4	6	5	3	3	4	8	6	8	10	4	5	9	6	5	6	7	5	5
12	5	9	6	8	5	5	9	8	9	9	7	18	9	4	4	8	17	13	10	8	6	5	7	19	9
13	20	18	16	15	11	12	13	13	9	6	5	4	4	8	12	9	10	8	14	13	7	13	11	16	11
14	18	M	14	9	8	11	14	11	12	11	8	8	5	5	7	7	6	14	9	6	5	5	5	5	9
15	9	11	6	3	2	3	12	14	15	13	10	8	7	11	13	9	10	10	7	11	15	12	16	13	10
16	10	6	3	2	2	4	4	8	16	21	20	19	19	11	8	10	8	10	9	6	6	5	6	5	9
17	5	3	5	5	3	3	4	5	8	8	10	6	9	11	14	18	19	12	10	8	8	9	10	7	8
18	6	8	7	7	7	6	8	7	4	7	5	6	5	6	7	5	7	7	8	6	7	8	10	7	
19	9	7	7	6	4	4	5	9	10	8	6	7	12	9	8	10	5	10	13	10	6	10	12	9	8
20	8	6	4	4	3	2	3	4	10	9	9	9	10	9	10	12	9	8	5	6	9	5	4	6	7
21	7	6	2	4	6	6	4	7	10	14	8	9	5	4	7	7	6	13	15	14	16	14	12	5	8
22	5	8	6	4	3	6	6	6	10	8	7	8	7	5	10	6	5	4	5	6	9	7	5	11	7
23	9	9	7	9	5	5	3	4	4	2	3	4	7	9	7	9	10	6	10	9	8	8	9	7	7
24	5	7	7	5	5	5	5	4	6	6	5	7	13	12	11	12	11	7	5	7	8	11	9	11	8
25	10	7	6	5	4	3	3	2	3	3	6	7	6	9	6	8	8	6	8	10	10	11	12	13	7
26	7	10	12	10	10	9	9	8	6	5	5	9	7	8	14	15	11	8	7	13	13	10	13	11	10
27	7	4	3	4	4	5	7	8	6	6	7	10	7	10	11	9	11	15	10	9	9	8	9	8	
28	6	M	5	5	5	4	4	9	11	17	23	16	12	14	14	14	9	12	16	13	16	17	12	27	12
29	37	43	33	17	16	16	17	31	34	21	17	13	11	10	9	19	9	7	8	13	22	19	23	8	19
30	4	4	3	2	2	3	5	8	10	10	11	10	8	8	11	13	9	6	4	4	4	4	4	4	6
31	2	1	1	1	2	2	2	2	5	3	3	4	4	5	7	7	7	6	5	4	4	3	3	4	4

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES				
		50	90	95	98	99	1	-	43	4	-	19	2				VALID	DATA	ABOVE	LIMIT	LEVEL
7	7	8	7	14	17	23	33	1	-	43	4	-	19	2	100	0	0	0	0	0	

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : POK FU LAM
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	8	5	3	3	3	4	4	3	3	8	3	1	3	3	3	2	3	3	3	3	3	4	4	M	4	
2	8	5	2	5	4	1	5	2	6	6	8	3	0	3	3	4	3	2	2	2	2	3	2	3	M	4
3	8	7	4	3	3	1	5	3	4	8	12	11	3	2	2	2	1	2	2	2	2	3	3	3	M	4
4	11	6	5	6	3	3	2	5	4	15	16	10	2	2	2	1	2	2	2	3	3	3	3	3	M	5
5	10	4	3	3	3	3	5	3	6	17	18	11	1	2	3	3	2	2	3	3	4	3	4	M	5	
6	9	4	3	3	3	3	3	2	5	14	17	13	7	4	0	4	6	3	3	2	4	1	4	3	M	5
7	6	6	4	3	2	2	4	3	4	10	15	14	12	11	6	2	2	3	2	2	2	3	3	3	M	5
8	10	5	3	3	3	3	4	2	4	7	12	13	13	13	12	6	3	2	2	2	3	3	3	3	M	6
9	13	7	4	3	3	3	3	4	5	10	14	13	9	8	2	2	3	2	2	1	3	3	3	3	M	5
10	11	6	4	4	3	3	4	4	5	6	12	17	16	15	14	13	11	9	3	2	3	3	4	M	7	
11	11	4	3	3	3	3	3	4	5	15	22	17	13	7	3	6	3	2	3	3	3	3	3	3	8	6
12	3	3	3	4	3	2	3	4	5	3	2	3	6	6	3	2	M	10	3	2	3	3	3	3	M	4
13	11	4	6	4	2	5	2	6	3	12	16	20	18	17	16	13	6	3	3	4	4	5	6	7	8	
14	4	5	3	6	4	3	7	3	5	3	3	14	15	11	11	10	7	7	6	7	6	9	10	9	7	
15	13	13	12	11	7	8	7	6	5	15	22	14	9	11	11	11	10	11	17	18	14	14	14	13	12	
16	12	14	14	13	14	14	14	14	M	28	17	13	15	14	13	15	15	15	15	15	16	16	16	M	15	
17	21	18	17	18	17	16	20	21	22	22	23	20	21	20	20	17	16	16	14	19	18	19	18	M	19	
18	1	0	0	0	0	0	1	3	2	1	1	0	1	0	2	3	1	2	4	3	5	2	5	2		
19	2	2	2	3	3	3	4	3	5	5	3	4	4	5	5	6	5	5	6	6	7	6	5	M	4	
20	7	2	1	1	5	8	11	6	4	5	5	4	5	2	0	20	5	3	3	1	2	1	0	M	4	
21	8	7	6	3	3	0	1	0	3	2	4	2	2	1	2	0	0	2	1	3	2	2	3	M	2	
22	10	6	6	2	2	2	0	0	0	2	7	12	13	13	11	9	6	3	0	0	3	4	5	M	5	
23	11	8	7	7	6	6	6	7	10	17	M	41	19	21	21	23	23	M	0	0	0	0	1	1	6	11
24	1	1	0	0	2	1	1	1	2	1	0	3	3	0	0	0	0	0	0	0	1	1	1	11	1	
25	2	2	2	2	1	1	1	1	2	1	4	1	0	0	0	0	0	0	0	0	1	0	1	4	1	
26	2	2	2	2	2	2	2	2	2	3	4	15	0	0	0	0	0	0	0	0	0	0	0	0	5	2
27	1	2	2	2	2	1	2	1	2	3	5	10	2	0	1	M	4	1	3	4	4	4	4	8	3	
28	4	4	4	4	4	4	4	4	4	4	6	10	14	6	3	1	2	1	2	3	4	4	4	5	10	5
29	7	9	7	5	5	4	5	5	8	7	6	10	4	2	1	1	2	3	3	4	4	4	4	4	8	5
30	4	4	4	4	4	4	4	4	4	4	5	2	3	3	3	2	2	3	3	3	4	3	4	7	4	
31	4	4	4	3	4	5	4	4	3	4	4	3	4	2	3	3	4	4	4	4	4	3	3	2	5	4

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	-	PERCENT	ABOVE LIMIT	LEVEL	97					97	0	
4	4	6	4	14	17	20	22	0	-	41	1	-	19	2				97	0	

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : POK FU LAM
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	3	2	1	3	2	1	4	9	3	9	8	6	4	5	6	6	4	3	5	5	7	5	5	4	5	
2	2	4	2	3	1	4	6	6	6	6	4	11	11	7	13	16	18	6	5	9	2	9	4	7		
3	2	3	4	6	5	6	4	4	6	5	7	7	6	4	6	3	9	7	3	3	2	2	4	3	5	
4	2	M	7	5	4	4	6	9	10	15	11	15	14	10	14	10	14	17	12	4	4	3	1	2	8	
5	2	0	1	1	1	3	4	10	17	22	29	20	26	17	18	18	14	14	17	11	11	11	5	9	12	
6	5	3	5	5	2	2	11	11	6	23	28	32	28	23	9	16	25	18	17	31	30	27	5	6	15	
7	3	2	2	4	2	4	5	8	13	11	9	13	11	5	5	11	19	17	16	6	5	5	5	2	8	
8	3	2	2	1	5	10	4	5	6	9	13	12	14	13	14	10	12	18	8	4	4	3	2	7	8	
9	4	4	7	5	4	5	5	3	6	10	8	7	7	9	9	7	6	6	9	4	3	6	3	5	6	
10	5	3	3	5	3	2	5	7	6	14	9	9	10	12	10	9	12	10	14	7	5	3	2	6	7	
11	2	3	4	6	2	5	4	5	6	4	3	5	11	8	11	9	4	7	11	4	4	4	4	2	5	
12	3	5	6	4	6	4	8	5	12	10	11	14	7	14	9	19	M	20	7	4	3	2	3	8	8	
13	15	12	10	12	9	11	8	11	2	4	3	9	5	5	14	12	9	9	4	13	3	3	4	3	8	
14	7	2	4	6	5	10	11	5	5	5	4	9	6	2	3	3	2	9	11	4	3	3	5	6	5	
15	9	7	3	2	4	4	7	7	10	12	10	4	7	16	17	11	9	14	10	19	17	22	24	15	11	
16	9	6	4	4	4	3	9	10	12	M	19	10	9	4	4	7	7	6	9	5	5	4	3	1	7	
17	6	2	4	4	1	2	7	11	9	7	8	4	6	6	10	8	10	5	6	12	8	6	7	3	6	
18	6	M	8	6	7	5	7	10	11	8	4	5	4	4	4	3	4	3	6	9	4	5	7	6	6	
19	6	7	7	6	4	5	5	10	9	5	2	2	8	5	7	11	3	6	11	9	3	6	9	7	6	
20	8	5	3	5	4	1	3	3	11	9	8	14	13	6	9	13	11	10	5	4	13	5	4	5	7	
21	7	8	2	4	7	3	4	6	10	15	8	10	5	3	6	6	6	11	11	11	14	3	6	2	7	
22	1	6	4	2	2	8	6	6	5	4	4	11	9	5	11	7	3	2	2	6	5	8	3	4	5	
23	8	8	5	8	4	5	3	2	2	1	4	7	13	12	6	4	6	4	7	5	4	5	6	3	6	
24	6	7	7	5	7	6	6	4	6	10	10	12	20	14	9	13	12	8	5	6	4	8	5	7	8	
25	6	6	5	3	4	2	2	3	3	11	9	10	8	7	5	12	13	4	4	8	6	8	6	6	6	
26	4	8	9	7	7	7	9	3	3	10	M	2	12	13	23	18	18	10	0	0	0	0	0	0	7	
27	0	0	0	0	0	0	0	0	0	7	6	1	3	8	M	7	11	9	2	3	5	2	4	3		
28	2	5	0	0	0	0	0	5	10	22	25	15	4	6	5	7	3	12	20	16	22	28	24	55	12	
29	57	88	63	35	28	27	43	46	52	37	23	18	11	10	8	21	5	3	6	18	31	26	46	53	31	
30	18	0	0	0	0	0	1	2	22	18	0	0	0	0	0	1	0	0	0	0	0	0	0	0	3	
31	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	11	1

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	31	2	99	0	ABOVE LIMIT					0	0	0
6	6	8	6	15	21	29	45	0	-	88	1	-	31	2	99	0	0	0	0	0

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : AP LEI CHAU
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	3	3	3	3	3	3	3	3	3	3	3	3	3	3	4	4	3	3	3	3	3	3	3	3	3
2	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
3	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3
4	3	3	3	3	3	3	3	3	4	4	4	4	3	4	4	4	5	4	3	3	3	3	3	3	3
5	3	3	3	3	3	3	3	4	4	4	4	4	4	3	4	3	3	3	3	3	3	3	3	3	3
6	3	3	3	3	3	3	3	3	4	4	4	4	4	4	3	4	5	5	5	4	3	4	4	4	4
7	4	3	3	3	3	3	4	4	3	4	4	4	4	4	3	3	3	3	3	3	3	3	3	3	3
8	3	3	3	3	3	3	3	3	4	4	4	3	4	3	4	3	4	4	3	3	3	3	3	3	3
9	3	3	3	3	3	3	3	3	4	3	3	3	3	4	4	3	3	4	3	3	3	3	3	4	3
10	3	3	3	3	3	3	4	4	4	4	4	4	4	4	4	4	3	3	4	3	3	3	3	4	4
11	4	4	3	3	3	3	4	4	4	4	4	3	4	4	4	3	4	4	4	4	4	4	3	4	4
12	4	4	3	3	4	3	3	4	3	3	4	4	3	3	4	4	3	3	3	3	3	3	4	3	3
13	4	4	3	4	4	3	3	3	4	3	4	3	4	3	3	4	3	3	4	5	6	4	3	3	4
14	4	6	4	3	3	4	3	4	4	4	4	4	4	4	4	4	4	4	4	3	3	3	4	4	4
15	5	4	4	4	3	4	4	6	4	4	4	3	3	3	4	4	4	4	4	4	4	5	4	4	4
16	4	4	4	4	3	3	4	4	5	4	4	4	4	3	4	4	4	3	3	3	3	3	3	4	3
17	3	3	3	3	3	3	3	3	3	4	3	3	4	4	4	3	3	3	3	3	3	3	3	3	3
18	3	3	3	3	3	3	3	3	3	3	3	3	4	4	4	4	4	4	3	3	3	3	3	3	3
19	3	3	4	4	3	3	3	4	4	4	4	4	4	4	3	4	4	4	3	3	4	4	3	4	4
20	3	4	3	3	3	3	3	4	4	3	3	4	4	4	3	4	3	3	4	3	3	3	3	3	3
21	3	3	3	3	3	3	3	3	3	4	3	3	3	4	3	3	4	4	3	3	3	3	3	3	3
22	3	3	3	3	3	3	3	3	4	4	4	4	4	4	3	4	4	3	3	3	3	3	3	3	3
23	3	4	3	4	3	3	4	4	4	4	4	4	4	4	4	4	M	6	4	4	4	4	4	8	4
24	6	5	5	4	4	5	4	4	4	4	4	4	6	4	4	4	3	3	4	4	4	4	4	4	4
25	4	4	4	4	4	4	4	3	4	4	4	4	4	3	4	4	4	4	4	4	4	4	4	5	4
26	6	5	6	5	4	4	5	4	4	5	4	4	4	4	4	4	3	4	4	4	4	4	3	4	4
27	4	4	4	4	4	4	5	5	5	5	5	5	4	4	4	4	3	3	4	4	3	4	3	4	4
28	3	4	4	4	3	4	4	7	4	6	4	4	3	4	4	4	4	4	4	3	3	3	4	9	4
29	7	7	7	5	5	5	6	8	6	5	4	4	3	3	3	3	3	3	4	3	3	3	3	3	4
30	3	3	3	3	3	3	3	3	3	4	3	3	3	3	3	3	4	3	3	4	3	3	3	3	3
31	3	3	3	3	3	3	3	3	3	4	3	3	3	3	4	3	3	3	3	3	3	3	3	3	3

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES						RANGE			STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES		
		50	90	95	98	99	1-HR	9	3	-					100	0	ABOVE LIMIT
3	3	4	3	4	5	6	6	3	-	9	3	3	4	1			

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : AP LEI CHAU
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	18	11	6	13	9	6	15	8	8	21	10	5	6	5	6	9	10	8	13	6	16	10	16	11	10
2	7	11	8	7	12	22	15	15	14	9	10	9	12	12	10	14	17	24	16	16	19	10	21	14	14
3	18	14	10	13	16	14	18	18	12	14	16	14	15	14	17	12	15	21	14	11	9	24	25	18	16
4	22	27	25	11	11	4	15	18	17	21	26	24	26	15	21	23	24	18	26	14	21	23	14	11	19
5	14	7	8	10	11	27	18	26	40	38	38	35	30	28	24	26	22	23	18	16	21	10	9	8	21
6	15	M	16	10	12	18	35	20	21	35	28	27	23	16	18	47	76	77	72	62	38	32	28	23	33
7	23	13	17	7	9	25	33	18	16	13	25	25	25	13	17	23	33	20	19	19	17	23	19	12	19
8	22	23	19	14	14	13	10	16	17	14	15	19	13	15	13	16	16	17	15	17	13	14	9	11	15
9	10	8	10	8	10	11	8	8	12	10	13	13	12	11	11	12	10	12	10	14	11	11	15	16	11
10	16	12	17	8	21	17	30	21	20	22	21	17	16	14	17	16	15	15	20	17	19	11	8	13	17
11	8	9	19	9	11	19	19	18	9	8	12	11	19	17	15	16	15	21	16	15	24	16	19	12	15
12	24	23	13	13	8	15	25	19	15	11	31	26	11	9	12	15	28	22	13	14	21	19	39	27	19
13	42	31	30	38	29	27	30	23	17	17	14	25	18	16	21	18	17	18	44	66	72	32	27	42	30
14	57	44	30	24	12	23	16	23	27	22	23	16	22	24	31	27	31	38	31	24	19	14	33	48	27
15	42	32	27	13	15	25	28	37	10	14	13	12	16	30	30	24	22	25	40	44	49	37	44	27	
16	34	30	20	14	18	21	34	33	21	19	25	25	14	7	14	15	8	17	17	21	16	11	15	11	19
17	17	16	24	21	11	12	14	12	15	19	16	15	28	18	14	16	15	15	13	10	19	18	15	14	16
18	12	18	16	9	14	12	16	20	14	18	16	17	18	17	12	14	13	23	19	19	14	17	16	25	16
19	19	13	14	12	7	21	20	20	28	18	14	14	21	16	26	24	29	32	21	17	12	21	29	22	20
20	15	M	15	10	21	12	8	13	27	20	18	25	16	15	18	20	19	19	12	25	19	17	15	18	17
21	16	9	20	16	22	20	24	22	26	18	20	20	18	17	11	17	27	32	28	45	34	23	23	6	21
22	10	11	12	13	7	17	23	11	9	14	14	18	12	14	12	18	17	14	23	19	17	16	24	25	15
23	25	29	22	22	16	17	12	17	15	15	17	19	22	22	10	19	21	19	31	36	25	20	24	12	20
24	23	20	22	20	22	24	20	10	12	14	17	18	36	25	25	30	18	18	25	19	27	31	29	35	23
25	33	21	21	21	12	11	8	9	11	15	19	17	8	9	15	21	23	29	30	30	29	33	28	32	20
26	37	31	38	28	27	27	26	19	15	18	16	18	22	23	33	36	25	24	17	27	23	21	28	19	25
27	17	12	20	22	20	21	24	22	19	23	23	23	18	27	24	23	27	34	21	21	22	25	33	17	22
28	17	16	14	18	14	12	20	43	28	42	27	40	30	36	25	25	22	22	33	26	47	41	47	97	31
29	75	71	57	25	26	35	55	45	28	17	11	10	9	7	6	7	5	5	9	16	39	28	14	10	25
30	7	6	4	6	4	5	8	10	7	7	5	3	3	3	5	6	5	4	6	7	9	6	6	5	6
31	3	4	5	5	7	7	6	5	8	6	7	6	6	7	7	4	4	5	5	7	8	4	5	6	6

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEVIATION	VALID	DATA	ABOVE	LIMIT				0		
MEAN	MEAN	17	31	38	47	64	3	-	97	6	-	33	2	100					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : CHEUNG CHAU
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	3	3	2	2	2	2	2	2	2	2	2	2	2	3	2	2	2	2	2	2	2	2	2	6	2	
2	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	4	2	
3	3	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	1	2	2	2	7	2	
4	3	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	2	2	2	2	5	2	
5	3	2	2	2	2	2	3	3	3	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	M 2	
6	7	4	3	3	3	2	2	2	3	2	2	2	2	3	1	3	2	2	2	2	2	2	2	6	3	
7	3	2	2	2	2	2	2	2	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	M 2	
8	7	4	4	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	9	3	
9	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	11	2	
10	4	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	M 2	
11	6	4	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	M 2	
12	5	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	6	2
13	4	2	2	2	2	1	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	2	2	9	2
14	5	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	3	3	4	12	3	
15	6	3	3	3	3	3	3	3	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	5	3
16	3	3	3	3	2	2	3	4	3	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	11	3
17	4	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	7	2
18	3	3	3	2	2	2	2	2	2	2	1	2	2	2	2	2	2	2	1	2	2	2	2	2	M 2	
19	5	3	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	11	3
20	4	3	2	2	2	2	2	2	2	2	2	2	2	2	1	2	2	2	2	2	2	1	1	2	12	2
21	4	3	3	2	2	2	2	2	3	3	M	5	4	4	4	5	5	5	5	5	5	5	6	14	4	
22	8	8	8	8	9	9	9	9	10	10	10	10	10	11	12	11	11	11	12	12	12	13	25	11		
23	16	15	14	14	14	15	15	16	17	16	16	16	16	16	18	17	18	18	18	18	19	19	19	31	17	
24	6	5	5	5	5	5	5	6	7	7	6	6	7	8	8	8	8	9	9	9	9	9	9	22	8	
25	9	7	7	7	7	10	10	10	11	11	11	10	11	9	9	10	11	10	11	11	11	11	11	20	10	
26	9	8	8	9	9	9	10	10	11	12	14	13	15	15	15	14	13	15	14	15	15	16	16	26	13	
27	4	4	4	5	7	8	8	7	7	7	6	6	7	3	2	3	4	5	5	5	6	6	19	6		
28	10	9	9	9	9	9	10	10	11	11	11	12	10	12	12	12	13	12	13	13	13	14	16	21	12	
29	5	4	4	4	5	5	5	6	7	7	8	9	10	10	11	12	13	13	14	14	16	16	16	30	10	
30	6	6	7	8	8	9	9	10	11	11	11	12	12	1	2	2	2	3	3	3	4	4	4	25	7	
31	11	10	9	9	10	10	10	11	11	11	11	11	11	12	12	12	13	13	14	14	15	16	M	12		

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1-HR	-	31	2	24-HR	-	17				99	0	ABOVE LIMIT
4	2	5	2	12	15	18	20	1	-	31	2	-	17	2					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: AUGUST

STATION : CHEUNG CHAU
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	8	7	6	7	6	4	8	7	5	4	7	3	2	3	2	2	2	3	4	5	5	6	8	8	5	
2	11	4	5	5	5	7	11	5	3	4	1	1	2	3	5	6	4	3	8	16	20	17	12	17	7	
3	11	9	7	7	11	9	9	12	13	7	4	5	8	6	5	4	4	5	7	12	13	22	16	15	9	
4	13	12	9	6	4	5	16	22	13	7	9	9	6	9	8	10	7	10	6	13	16	4	25	12	10	
5	32	22	12	10	17	43	50	42	31	17	23	17	10	15	12	16	17	19	63	54	11	11	11	11	24	
6	17	23	27	37	9	7	11	50	62	36	12	11	11	15	48	67	41	47	66	112	102	119	80	45	44	
7	41	56	45	39	28	32	56	83	59	31	12	13	13	6	5	5	17	15	54	63	26	17	8	7	30	
8	8	10	5	6	6	7	4	7	6	5	7	6	4	7	11	5	9	11	15	14	16	11	8	6	8	
9	9	7	3	4	3	4	3	6	3	5	5	4	5	2	4	5	4	3	5	7	15	22	12	9	6	
10	12	12	18	8	6	12	20	8	16	19	8	7	5	9	5	6	4	6	7	16	8	9	10	15	10	
11	12	10	7	9	13	11	15	9	9	7	9	10	11	4	3	5	6	6	11	10	16	17	13	32	11	
12	20	10	15	14	5	8	10	8	18	21	48	11	3	3	3	5	9	8	9	13	43	23	56	53	17	
13	38	34	33	24	19	9	11	14	14	16	15	5	2	6	5	8	15	45	57	69	67	63	52	34	27	
14	41	M	47	58	59	40	13	34	29	14	8	10	17	10	20	25	27	26	35	58	64	59	45	33	34	
15	42	30	32	32	36	36	40	40	29	29	7	8	13	31	22	23	15	17	25	23	27	53	48	24	28	
16	28	33	37	39	29	38	47	47	37	41	27	33	19	7	5	9	12	8	8	9	11	11	10	13	23	
17	22	7	11	14	20	12	3	7	4	8	8	26	13	7	18	23	27	40	38	16	18	24	8	14	16	
18	19	23	18	20	13	15	16	5	8	26	19	16	6	10	16	16	13	16	17	15	14	11	7	20	15	
19	13	13	14	6	12	12	10	13	10	7	13	12	20	14	26	37	31	17	17	8	12	14	11	12	15	
20	13	7	13	7	4	9	3	5	9	8	9	11	12	13	9	11	8	8	18	17	12	20	8	11	10	
21	8	6	9	6	9	11	11	10	8	8	8	7	M	7	6	7	7	9	6	8	16	31	25	46	56	14
22	51	33	41	31	39	46	40	31	32	33	29	14	14	10	17	10	9	38	30	48	29	39	56	49	32	
23	32	31	40	32	26	24	31	36	30	15	13	7	10	9	9	5	11	22	26	16	15	17	19	18	21	
24	25	20	22	30	20	18	22	17	22	21	11	7	10	13	5	6	6	4	10	11	35	25	17	21	17	
25	19	17	15	15	17	31	28	17	10	9	10	10	7	5	2	4	6	14	19	32	42	42	49	39	19	
26	45	41	35	25	29	27	38	28	26	15	10	14	12	11	8	5	6	12	11	14	12	29	11	12	20	
27	18	16	10	7	11	16	12	9	9	9	9	5	8	11	7	11	13	11	20	17	15	35	10	12		
28	18	M	11	12	9	10	38	45	42	43	26	15	15	16	15	13	19	37	28	7	37	39	24	40	24	
29	38	32	21	18	39	31	46	61	59	44	26	12	8	12	12	17	19	14	9	52	61	46	48	56	33	
30	52	41	6	7	10	6	8	27	49	27	7	2	3	5	3	2	3	3	5	12	6	9	9	5	13	
31	7	13	30	31	38	39	32	27	28	22	10	14	22	21	18	5	5	4	3	9	10	9	11	31	18	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE			STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	ABOVE				0	0	0
MEAN	MEDIAN	MEAN	50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	100	100	100	0	0	0
13	13	18	13	41	50	61	67	1	-	119	5	-	44	2				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : VICTORIA PEAK
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	0	0	0	0	0	0	0	0	0	0	0	0	1	1	1	3	3	1	0	0	0	0	0	0	0
2	0	0	0	0	0	0	0	0	0	0	0	1	1	1	2	3	3	1	1	1	1	1	1	1	1
3	1	1	1	1	0	0	1	1	1	1	2	2	2	2	4	5	5	3	2	2	2	2	2	1	2
4	1	1	2	2	1	2	2	2	2	3	3	3	3	4	5	4	3	3	3	3	3	3	3	2	3
5	2	2	3	3	3	3	3	3	3	4	3	4	4	4	4	4	4	4	4	4	4	4	4	3	3
6	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	6	3
7	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	2
8	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	1
9	1	1	1	1	1	1	1	1	2	2	2	2	1	1	2	2	2	2	1	1	1	1	1	1	1
10	1	1	1	1	1	1	1	1	2	2	2	3	2	3	4	5	6	6	3	2	2	2	2	2	2
11	2	2	2	2	2	2	2	2	3	3	4	4	3	5	7	8	8	8	6	4	4	4	4	3	4
12	2	3	3	3	3	3	3	3	4	4	4	5	5	5	5	8	9	8	6	4	4	4	4	3	4
13	3	3	3	4	4	3	4	4	4	4	4	5	5	6	8	9	9	8	5	4	5	4	4	5	5
14	3	4	4	4	4	4	4	4	4	4	4	5	5	5	4	4	5	5	4	4	5	5	5	4	4
15	3	4	4	4	4	4	4	4	4	4	4	5	5	5	6	6	6	5	6	5	5	5	5	5	5
16	4	5	4	4	4	4	5	5	5	5	5	5	5	5	6	6	6	5	5	5	5	5	5	5	5
17	4	4	5	5	5	5	5	5	5	6	6	6	6	7	10	11	11	10	7	5	6	5	6	4	6
18	4	4	4	5	5	5	5	5	5	5	5	5	5	6	6	6	7	6	5	5	5	5	5	4	5
19	4	4	4	4	5	5	5	5	5	5	5	5	5	6	6	7	9	9	7	6	5	5	5	5	4
20	4	5	5	5	5	5	5	5	5	6	6	6	7	7	7	7	7	6	6	5	6	6	6	5	6
21	5	5	5	5	5	5	5	5	5	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6
22	5	5	5	5	5	5	5	5	5	6	6	6	6	6	6	6	6	6	6	6	5	6	5	6	5
23	4	5	5	5	5	4	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5
24	4	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	5	4	5
25	4	5	5	4	5	5	5	5	5	5	5	5	5	6	6	6	7	8	7	6	5	5	5	4	5
26	4	4	4	5	5	5	5	5	5	5	5	5	5	6	7	8	10	9	7	6	5	6	6	5	6
27	5	5	5	5	5	5	5	5	5	6	6	6	7	7	9	10	11	9	6	6	6	6	7	5	6
28	5	6	6	6	6	6	6	6	7	7	7	8	8	9	8	8	7	7	7	7	7	7	7	5	7
29	5	5	6	5	6	6	6	6	6	7	7	7	7	7	8	10	10	8	7	7	7	7	7	6	7
30	6	6	6	6	6	6	7	7	7	7	7	7	8	10	11	13	12	9	8	8	8	8	7	8	7

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES			
		50	90	95	98	99	0	-	13	0	-	8	2				VALID	DATA	ABOVE	LIMIT
4	5	4	5	7	8	9	10	0	-	13	0	-	8	2	100	0	0	0	0	0

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : VICTORIA PEAK
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	0	1	0	0	0	4	1	8	8	12	4	2	4	2	2	5	4	9	13	17	19	23	14	26	7	
2	26	21	5	21	28	2	0	6	8	9	15	11	12	17	17	15	19	32	6	1	1	0	18	12		
3	14	5	9	8	11	14	13	23	28	23	33	40	23	24	25	21	26	22	27	13	13	11	7	5	18	
4	3	2	0	0	0	2	2	5	12	22	24	22	19	19	24	29	25	19	19	3	4	2	1	2	11	
5	2	1	0	1	1	0	4	4	6	9	6	9	5	6	7	4	4	1	2	1	0	0	0	0	3	
6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	1	0	M	M	M	M	0	
7	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
8	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
9	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
10	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
11	6	M	5	4	4	4	8	20	16	21	36	18	10	8	8	11	14	21	25	33	23	11	12	28	15	
12	23	33	42	26	5	5	6	35	28	26	17	21	14	17	14	15	15	15	22	46	56	62	32	19	13	25
13	14	12	7	5	3	3	10	12	12	8	13	13	9	10	6	8	12	17	7	5	3	2	4	6	8	
14	7	4	4	4	4	5	6	11	12	7	9	7	7	16	2	11	20	21	30	33	37	29	30	43	15	
15	42	27	14	18	23	26	20	25	15	11	25	30	17	13	20	21	23	29	26	25	16	23	11	41	23	
16	47	32	8	3	5	4	8	10	12	15	13	11	16	14	15	14	13	12	12	7	21	11	8	4	13	
17	5	2	2	4	4	5	9	14	21	23	18	13	9	12	11	7	4	2	3	3	8	6	10	5	8	
18	5	4	3	3	4	4	4	5	4	6	6	3	4	3	4	4	2	4	2	5	1	2	3	3	4	
19	5	3	2	1	2	3	5	8	8	9	10	9	10	8	11	7	7	11	7	5	4	3	4	5	6	
20	8	5	4	3	3	4	7	11	16	17	12	12	11	13	22	20	19	20	18	8	6	6	5	26	12	
21	23	9	33	15	13	9	15	17	15	25	35	25	8	17	18	14	9	4	4	3	3	2	2	5	13	
22	3	2	4	3	2	2	10	13	10	20	22	19	11	17	16	13	14	22	25	17	15	14	12	14	13	
23	9	5	5	4	4	4	7	15	15	20	20	8	10	7	10	11	8	4	9	5	5	6	7	5	8	
24	2	3	1	1	2	7	0	2	5	15	13	9	3	7	9	12	12	22	18	9	4	8	8	4	7	
25	4	M	5	5	3	4	8	13	12	12	6	6	3	5	5	7	5	10	15	8	12	10	7	8	8	
26	13	9	10	4	4	4	4	9	10	7	6	7	8	12	11	12	15	17	15	11	8	7	8	6	9	
27	4	3	8	6	8	13	10	8	18	22	12	11	8	8	14	12	15	18	19	10	10	6	6	8	11	
28	9	9	7	9	21	8	22	22	27	33	30	31	32	30	29	24	20	13	9	7	6	5	4	6	17	
29	5	3	3	3	3	3	5	8	10	5	8	11	13	10	11	10	16	20	23	14	14	11	7	8	9	
30	14	21	16	15	19	14	24	18	20	26	25	25	25	25	29	29	29	31	30	34	46	36	26	31	25	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEVIATION	VALID	DATA	ABOVE	LIMIT				0	0	0
MEAN	MEDIAN	MEAN	9	25	30	35	42	0	-	62	0	-	25	2	88				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	1	0		
2	3	2	7	3	3	3	3	5	3	3	0	3	2	2	5	3	2	3	4	3	3	3	3	0	3	
3	0	0	0	0	0	0	2	3	0	2	4	2	1	0	0	1	1	0	3	2	0	15	11	0	2	
4	11	63	26	16	13	18	17	6	18	0	1	1	0	0	0	0	0	1	1	0	0	0	0	0	8	
5	0	0	3	3	4	4	1	1	0	1	0	0	0	1	1	0	1	0	3	1	0	0	1	3	1	
6	2	4	5	5	3	4	4	2	1	0	0	1	3	0	1	0	2	1	0	0	0	1	0	0	2	
7	0	0	3	7	1	6	1	1	0	0	0	0	0	0	0	0	0	1	3	1	0	0	1	0	1	
8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	6	0	0	1	2	1	1	1	
9	0	0	0	0	0	0	3	2	3	2	0	0	0	2	2	1	0	0	0	3	3	2	3	2	1	
10	1	1	3	3	2	3	2	2	3	1	0	0	0	0	0	0	0	0	3	1	0	0	0	0	1	
11	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	1	1	2	1	1	0	
12	2	2	1	1	1	1	1	0	1	4	1	0	0	0	0	1	0	0	4	1	0	0	0	0	1	
13	1	1	1	1	1	1	0	0	0	0	0	0	0	0	0	2	0	0	3	1	1	3	3	0	1	
14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0	0	0	2	2	2	3	0	0	
15	1	2	3	2	3	3	3	1	0	0	0	0	0	0	1	0	2	3	2	6	6	5	5	5	2	
16	6	5	8	9	8	7	7	5	4	1	0	1	0	0	0	0	0	0	5	6	7	7	6	6	4	
17	7	7	8	8	8	9	9	7	4	3	2	1	0	0	0	0	0	0	3	8	8	8	9	13	5	
18	14	15	13	9	12	12	14	13	11	10	8	6	1	0	2	1	1	6	10	11	12	11	12	12	9	
19	12	12	13	14	14	14	14	11	11	10	8	3	0	0	M	M	6	14	16	16	16	16	17	17	11	
20	4	3	5	5	4	4	6	5	3	0	0	0	0	0	0	0	0	3	7	8	9	9	8	3		
21	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0		
22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	3	4	5	6	5	6	1		
23	4	6	6	6	5	5	4	3	5	2	0	0	0	0	0	0	3	3	2	2	3	1	4	3	3	
24	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	1	0		
25	8	6	7	8	6	9	9	5	4	7	8	3	0	0	0	0	0	5	10	10	9	9	11	6		
26	0	0	0	0	0	0	0	0	0	0	0	0	M	M	M	M	M	M	M	M	M	M	M	M		
27	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
28	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
29	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
30	M	M	M	M	M	M	M	M	M	M	M	M	M	M	8	1	0	0	0	0	5	8	8	11	10	11

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE			STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES ABOVE LIMIT LEVEL		
		50	90	95	98	99	1-HR	24-HR	11	2	87	0					87	0	
3	1	3	1	8	12	15	17	0	-	63	0	-	11	2					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : CHUNG HOM KOK ZONE SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	3	3	3	2	1	0	1	2	3	2	0	0	1	1	2	9	11	12	11	7	4	4	15	4		
2	18	16	43	12	12	22	19	27	34	41	27	15	14	18	27	21	9	15	16	9	4	9	5	10	18	
3	28	42	25	29	41	44	51	69	64	92	81	68	49	45	51	31	28	26	44	32	32	23	16	14	43	
4	8	5	4	5	6	7	8	10	8	43	79	71	47	34	52	60	41	24	12	7	4	4	4	8	23	
5	7	6	5	6	7	8	9	10	9	6	5	4	3	3	2	3	3	2	3	2	2	1	7	5		
6	6	5	5	5	5	5	5	5	5	5	5	4	4	4	5	6	7	9	11	7	7	6	6	9		
7	6	6	6	7	7	8	9	8	11	12	13	9	10	10	9	14	11	10	11	13	9	11	7	13	10	
8	8	11	10	7	8	7	9	15	20	16	11	9	9	9	7	7	11	15	8	7	12	9	12	9	10	
9	10	6	7	11	9	9	11	14	11	8	8	10	7	7	11	17	49	41	22	12	15	12	9	11	14	
10	8	12	37	23	4	4	6	9	9	7	4	5	4	4	5	7	6	9	11	8	8	10	5	11	9	
11	6	M	9	6	5	6	7	12	11	8	7	7	5	4	6	6	12	19	15	19	16	19	26	38	12	
12	30	26	19	17	18	13	15	17	36	47	23	22	15	9	11	9	11	34	33	29	10	5	8	21	20	
13	19	12	12	7	9	6	9	13	16	9	8	9	4	4	6	6	11	10	13	10	8	5	4	10	9	
14	5	10	5	3	4	5	8	11	12	9	7	6	6	8	15	13	12	28	28	19	53	54	62	59	18	
15	50	57	61	52	43	40	40	31	34	53	47	35	28	25	19	19	17	25	32	26	29	20	23	23	35	
16	20	17	6	5	8	6	7	8	8	9	8	9	7	8	8	6	6	8	16	13	10	5	9	9		
17	5	5	5	6	7	7	9	12	13	9	9	7	5	6	5	6	6	7	14	9	7	6	7	8	8	
18	8	13	5	5	7	6	6	6	5	5	5	5	4	4	5	6	4	4	6	6	3	4	7	7	6	
19	7	6	5	4	4	6	7	6	6	6	5	5	5	5	6	M	M	7	7	7	6	6	6	6		
20	7	10	6	7	6	5	8	11	10	10	8	6	4	6	8	11	16	26	17	12	9	8	6	23	10	
21	60	47	38	40	50	29	27	37	34	30	50	30	26	22	23	14	6	7	14	14	9	8	8	7	26	
22	7	10	8	7	3	4	6	8	9	10	10	9	9	9	8	13	10	10	12	10	10	8	7	7	9	
23	6	5	4	5	4	3	4	7	7	7	11	11	9	6	5	5	7	9	11	9	12	7	12	14	8	
24	11	8	10	7	15	7	14	19	17	14	22	8	8	14	14	9	12	12	9	12	10	11	11	9	12	
25	9	M	14	14	10	15	19	19	16	13	14	16	22	13	14	14	19	18	24	14	14	16	36	19	17	
26	20	27	25	18	19	19	13	22	26	22	17	16	M	M	M	M	M	M	M	M	M	M	M	M		
27	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
28	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
29	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
30	M	M	M	M	M	M	M	M	M	M	M	M	53	73	77	41	56	67	64	61	46	38	46	103	72	108

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES				
		50	90	95	98	99	0	-	108	4	-	43	2				VALID	DATA	ABOVE	LIMIT	LEVEL
11	9	15	9	36	50	64	73	0	-	108	4	-	43	2	86	86	0	0	0	0	0

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	11	11	11	11	11	11	11	11	12	11	11	11	11	11	12	12	12	12	11	11	12	11	11	11	11
2	11	11	11	11	11	11	11	11	12	13	12	11	12	12	12	11	12	12	12	11	11	11	11	12	12
3	11	11	11	11	11	11	11	12	12	14	13	13	13	12	12	12	12	12	12	12	12	11	12	11	12
4	11	11	11	11	11	11	11	12	11	12	14	13	13	12	12	12	12	12	12	11	11	11	11	12	12
5	11	11	12	11	11	12	12	11	11	12	12	11	11	11	12	12	12	12	12	11	11	11	11	12	11
6	11	11	11	12	11	11	11	11	11	11	11	11	11	11	11	11	11	12	11	11	11	12	11	11	12
7	11	11	11	11	11	11	11	11	12	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11
8	11	11	12	11	11	11	11	11	11	11	12	11	11	11	11	12	11	11	11	11	11	11	11	11	11
9	11	11	11	11	11	11	11	11	11	11	11	11	11	12	11	11	12	12	11	11	12	11	11	11	11
10	11	12	11	12	11	12	11	12	12	12	12	12	11	11	12	M	11	11	11	12	11	12	12	13	12
11	12	11	11	12	12	11	12	12	13	14	13	12	12	12	13	12	12	12	12	11	12	12	12	13	12
12	11	12	12	12	12	12	14	14	13	12	12	12	12	12	11	12	11	12	12	12	11	11	12	12	12
13	12	12	12	11	12	12	12	13	13	13	13	12	12	12	11	12	12	12	12	12	11	11	11	12	12
14	12	12	11	12	12	12	12	12	13	12	12	12	12	11	12	11	12	12	11	12	11	12	12	13	12
15	12	12	12	12	12	12	12	12	12	13	12	12	13	12	12	12	12	12	11	12	12	12	11	12	13
16	12	12	12	11	11	11	11	11	12	11	12	12	12	12	11	12	11	12	11	11	11	11	11	11	13
17	12	11	11	11	11	12	11	12	12	12	12	12	12	11	11	12	12	12	11	12	11	11	11	12	12
18	11	11	12	11	11	12	11	12	12	12	12	12	12	12	11	12	12	11	12	11	12	12	11	13	12
19	12	11	12	12	12	12	11	12	12	12	11	12	12	12	12	12	12	12	12	12	11	11	12	12	12
20	11	12	11	12	12	11	12	12	12	11	12	12	12	12	12	12	12	12	12	12	11	12	11	14	12
21	13	11	12	12	12	12	11	12	12	12	12	12	12	12	12	12	12	11	12	11	12	11	11	13	12
22	11	11	11	12	12	11	11	12	12	12	12	12	12	12	11	12	12	12	12	11	12	12	12	12	12
23	11	11	12	11	12	11	12	12	12	12	12	12	12	12	12	12	12	12	11	11	12	11	11	14	12
24	12	11	11	12	11	11	11	12	11	12	12	12	12	12	11	12	12	12	11	12	11	12	11	12	12
25	11	12	12	12	11	11	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	11	11	12	13
26	12	12	12	12	11	11	11	12	12	12	12	12	12	12	11	12	12	12	12	11	12	11	12	11	12
27	11	11	11	11	11	12	12	12	12	12	12	12	12	12	12	12	12	12	12	11	12	12	11	13	12
28	12	12	11	12	12	12	12	12	12	13	12	13	12	12	12	12	12	12	11	12	11	12	11	11	12
29	11	12	11	12	12	12	11	12	12	13	13	13	12	12	12	12	12	12	12	12	12	12	12	12	12
30	11	11	12	11	12	12	12	12	13	12	13	12	13	12	13	13	12	12	12	12	12	13	12	12	12

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEV	VALID	DATA	ABOVE	LIMIT				0	0	0
12	12	12	12	13	13	13	11	-	14	11	-	12	1	100					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT

STATION : VICTORIA ROAD SUBSTATION
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	3	2	6	2	4	1	3	3	10	7	7	5	6	6	14	16	21	17	10	10	12	18	18	7	9
2	14	10	7	6	4	3	5	9	15	11	8	9	10	10	16	23	21	36	25	12	9	10	14	10	12
3	15	12	4	10	17	15	17	21	26	31	32	36	45	32	21	22	17	25	23	19	15	12	14	10	20
4	23	18	11	21	8	6	20	19	23	30	29	26	23	25	24	21	25	34	33	11	6	4	4	4	19
5	4	4	3	3	3	3	5	7	8	8	7	8	7	6	7	7	6	3	3	2	2	1	1	1	5
6	1	1	1	1	0	1	1	1	1	0	0	1	1	2	2	2	2	2	3	2	2	2	1	1	2
7	1	1	1	1	1	1	2	3	6	7	8	6	7	6	6	7	7	4	4	3	2	2	2	3	4
8	2	1	2	2	1	1	3	6	9	10	7	4	3	4	3	3	3	2	4	4	7	8	4	4	4
9	3	2	2	2	2	2	5	5	7	7	18	13	10	19	14	20	18	23	15	16	10	9	11	10	
10	16	22	15	15	9	20	11	9	9	8	7	6	6	7	9	M	17	10	6	5	5	4	5	7	10
11	5	M	6	17	15	14	13	13	21	21	20	13	18	19	31	12	17	17	22	14	11	11	11	14	15
12	13	13	12	13	16	18	21	19	17	17	14	11	13	13	8	8	10	15	27	25	22	26	25	11	16
13	10	10	5	4	3	3	10	20	21	19	18	13	14	12	7	14	21	19	13	8	7	6	8	12	12
14	9	11	5	9	20	21	16	13	15	19	14	9	8	10	16	16	13	25	12	8	12	15	19	23	14
15	26	21	16	14	16	12	12	13	22	29	22	33	21	23	17	15	16	12	14	16	12	11	11	16	18
16	20	18	10	3	3	3	4	7	8	8	10	15	12	10	9	10	12	11	9	7	8	5	4	3	9
17	2	2	2	2	2	3	5	11	18	20	13	10	7	7	7	7	4	5	6	5	3	6	4	7	
18	3	4	4	3	2	2	2	3	4	4	3	2	3	3	3	3	3	4	3	2	3	3	3	3	
19	3	2	1	1	1	2	3	6	8	7	7	6	6	7	8	9	11	9	7	6	5	4	4	5	5
20	6	5	3	2	2	3	6	10	11	11	15	17	11	10	8	12	12	16	15	8	6	8	13	19	10
21	17	11	15	17	14	9	10	10	12	15	15	16	8	11	16	14	9	7	5	5	3	3	2	4	10
22	2	2	2	2	1	1	5	16	13	11	10	17	13	9	7	5	5	8	8	5	5	5	4	4	7
23	4	2	2	3	4	7	11	12	11	13	14	14	10	8	10	11	12	10	7	8	9	7	6	4	8
24	3	3	2	2	4	3	3	6	9	11	10	11	6	9	13	9	9	10	8	6	5	5	6	5	7
25	3	M	4	3	3	3	7	10	12	12	13	14	7	8	5	5	7	12	8	6	9	8	10	10	8
26	11	11	7	6	6	5	6	10	10	8	8	9	10	14	17	12	17	15	17	10	7	11	9	10	10
27	6	4	6	6	7	11	9	8	13	14	14	15	9	10	11	11	19	13	17	11	10	8	9	11	11
28	10	9	7	5	10	7	8	14	18	19	19	22	28	20	20	23	16	9	7	7	5	4	4	4	12
29	4	3	3	2	3	3	6	7	15	24	20	13	12	7	9	8	11	9	8	11	13	15	9	8	9
30	9	11	10	9	10	11	15	17	16	18	21	22	26	21	24	24	28	22	22	21	25	33	32	25	20

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES				
		50	90	95	98	99	0	-	45	1	-	20	2				VALID	DATA	ABOVE	LIMIT	LEVEL
8	9	10	9	20	23	29	32	0	-	45	1	-	20	2	100	0	0	0	0	0	0

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : POK FU LAM
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	4	4	4	4	4	4	4	4	4	4	4	4	5	3	2	3	3	4	4	4	4	4	4	6	4	
2	4	4	4	4	4	4	4	3	4	6	6	9	1	3	3	3	4	6	6	4	4	4	4	8	4	
3	6	5	5	5	5	5	4	5	6	8	10	5	4	7	6	6	5	6	7	5	5	5	4	7	6	
4	5	5	5	5	5	5	8	7	7	10	8	9	6	7	7	6	6	6	6	5	5	5	5	8	6	
5	6	5	5	5	5	5	6	5	5	5	6	6	5	5	5	5	6	5	5	5	5	5	5	8	5	
6	6	6	5	6	6	6	5	5	5	5	5	5	5	5	5	6	6	6	6	5	5	5	5	7	6	
7	5	5	5	6	5	5	5	5	5	5	5	4	5	4	4	5	4	5	5	5	5	4	4	6	5	
8	5	4	5	5	5	4	4	5	4	5	4	4	5	4	4	5	5	5	5	5	5	4	4	10	5	
9	6	5	5	5	5	5	5	4	4	4	5	5	5	5	5	5	5	5	5	5	5	5	4	8	5	
10	5	6	5	5	5	5	5	5	5	5	6	5	4	4	4	4	4	5	5	5	5	5	5	5	8	5
11	5	5	5	6	5	5	5	5	7	8	6	5	6	7	6	5	6	6	6	6	6	5	5	9	6	
12	6	6	5	6	6	6	7	9	8	7	6	7	6	6	4	5	5	6	7	6	6	6	6	9	6	
13	6	6	6	6	6	6	6	8	10	13	14	11	7	5	1	2	6	6	6	7	6	6	6	9	7	
14	6	7	7	7	8	9	8	7	8	12	14	10	4	1	2	6	7	7	7	7	7	7	8	11	7	
15	8	8	7	7	7	7	7	7	7	10	8	8	8	11	5	5	7	7	8	8	7	7	7	10	8	
16	8	8	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	7	10	7	
17	7	7	7	7	7	7	7	7	8	9	7	8	10	6	4	3	5	6	6	7	7	8	7	9	7	
18	7	7	7	7	7	7	7	7	8	8	8	7	7	6	6	7	7	7	8	7	7	7	10	7		
19	7	8	7	8	8	8	8	8	8	9	8	7	7	7	7	8	8	8	8	8	8	8	8	10	8	
20	8	8	8	8	8	8	8	8	8	9	10	9	7	9	8	8	7	8	8	8	8	8	8	11	8	
21	12	8	9	10	9	9	9	9	9	9	9	9	9	9	8	9	9	9	8	8	8	8	8	9	11	9
22	9	9	9	8	9	8	8	9	9	9	9	8	8	8	9	9	9	8	8	8	8	8	7	7	10	8
23	8	7	8	8	8	8	7	7	7	8	8	8	8	7	8	8	8	8	7	7	7	7	7	10	8	
24	8	7	7	8	8	8	7	7	7	8	8	8	8	8	8	8	8	8	8	8	7	7	7	11	8	
25	8	8	8	8	8	8	8	8	8	8	8	8	8	8	7	8	8	8	8	8	8	8	8	11	8	
26	9	8	8	8	8	7	8	8	8	10	10	8	10	7	4	7	8	8	9	8	8	8	8	10	8	
27	8	9	9	9	9	9	8	8	9	10	9	10	8	7	7	8	8	8	9	9	9	9	9	11	9	
28	10	9	9	9	9	9	10	9	9	9	11	12	12	11	10	9	8	7	8	9	9	9	9	12	10	
29	9	9	9	9	9	9	9	9	10	12	12	11	10	8	9	9	10	10	11	10	10	10	10	12	10	
30	10	10	11	10	10	11	11	11	12	15	18	19	14	10	10	M	6	8	13	13	14	14	15	17	12	

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	DEVIATION	NO. OF TIMES		
		50	90	95	98	99	1	-	19	4	-	12	1				100	0	ABOVE LIMIT
7	7	7	10	11	12	14	1	-	19	4	-	12	1	1	1	100	0		

- NOTES:
- FLAGS FOR INVALID DATA :
 - D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : POK FU LAM
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	0	M	1	0	0	0	3	12	9	13	6	2	1	0	2	2	7	12	6	13	20	27	15	10	7
2	14	12	5	5	0	0	6	11	9	8	3	6	5	11	12	20	20	45	40	6	1	1	9	30	12
3	41	11	11	33	32	24	26	33	40	49	52	32	38	35	25	22	17	25	50	26	13	4	5	9	27
4	27	23	5	2	0	10	51	37	36	51	36	33	23	40	44	36	44	36	46	1	0	0	0	1	24
5	0	0	0	0	0	0	0	5	7	1	1	1	0	0	1	0	0	0	0	0	0	0	0	0	1
6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
7	0	0	0	0	0	0	2	0	0	2	0	1	1	0	0	0	0	0	0	0	0	1	0	0	2
8	0	0	0	0	7	0	1	2	6	13	5	1	2	3	8	0	1	8	1	7	23	14	1	11	5
9	0	0	1	1	2	2	0	4	10	12	2	2	0	24	21	35	43	43	42	21	14	3	34	13	
10	29	48	48	43	8	14	3	4	2	0	0	0	0	0	3	6	8	1	0	0	0	0	0	8	9
11	1	6	17	49	14	5	8	22	33	32	31	12	24	11	7	1	11	22	37	20	9	8	9	17	17
12	14	14	9	18	26	29	33	34	23	18	9	4	4	7	4	7	3	29	44	37	51	51	46	24	22
13	23	10	5	6	2	0	23	39	39	30	26	14	16	14	3	8	25	14	3	0	0	0	0	22	13
14	0	5	3	27	61	45	34	29	24	26	22	9	5	1	6	12	20	43	25	26	27	35	71	68	26
15	60	M	29	26	33	27	26	31	38	50	43	42	21	18	13	9	10	5	10	10	5	10	9	41	25
16	34	33	12	0	0	0	0	0	0	1	2	2	3	7	6	2	5	9	10	4	16	5	2	0	6
17	0	0	0	0	0	0	0	17	28	25	14	9	0	0	0	0	0	0	0	3	0	0	0	4	
18	8	8	9	9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
19	0	0	0	0	0	0	0	0	1	2	1	0	1	0	1	2	0	3	6	4	0	0	0	1	
20	0	0	0	0	0	0	0	1	4	7	17	17	10	12	9	11	11	13	12	1	0	11	20	47	8
21	43	30	46	45	28	19	19	17	24	25	21	27	7	8	17	8	2	1	0	3	0	1	0	0	16
22	2	0	0	0	0	0	2	16	25	19	13	6	8	6	3	2	8	10	14	4	4	5	1	5	6
23	0	0	0	0	0	0	1	12	20	17	21	10	10	1	0	2	2	0	0	2	4	3	1	0	4
24	1	1	3	1	2	2	0	0	1	10	9	8	3	5	14	5	6	2	3	0	0	0	1	0	3
25	0	0	0	0	0	0	3	8	11	9	7	6	0	2	2	2	0	8	5	0	5	3	6	7	4
26	12	16	6	6	5	6	5	9	8	0	2	3	5	7	14	9	8	9	10	8	2	9	9	7	7
27	1	0	1	3	6	18	15	9	13	16	19	10	1	9	7	6	9	11	23	7	2	3	3	10	8
28	18	9	2	1	22	1	8	23	31	25	26	32	41	29	22	19	9	4	2	0	0	0	0	0	14
29	0	M	0	0	0	0	5	8	20	36	39	14	4	0	7	2	5	3	3	1	1	6	1	1	7
30	11	21	19	12	22	17	28	27	23	28	31	42	57	37	46	M	43	28	55	67	89	77	90	57	40

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEVIATION	VALID	DATA	ABOVE	LIMIT				0	0	0
MEAN	MEDIAN	MEAN	5	33	43	51	60	0	-	90	0	-	40	3	99				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : AP LEI CHAU
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	3	3	3	3	3	3	4	4	4	4	3	3	3	3	6	4	4	4	4	3	3	3	5	4	
2	5	5	5	4	4	4	5	8	10	6	4	4	4	4	4	6	3	4	4	4	4	4	4	5	5
3	6	5	4	4	5	5	5	7	9	10	8	12	7	5	4	3	3	4	4	4	4	3	3	3	5
4	4	4	4	4	4	4	4	4	7	12	10	8	6	6	6	5	7	5	4	4	4	4	4	4	5
5	4	4	4	5	4	4	5	5	5	4	4	4	4	3	4	4	4	4	4	4	4	4	4	4	4
6	4	3	3	3	3	3	4	3	3	4	3	3	3	3	3	3	4	3	3	3	3	3	3	4	3
7	3	3	3	3	3	3	3	3	3	3	4	4	3	3	3	3	3	4	3	3	3	4	3	3	3
8	3	3	3	4	3	3	3	3	3	4	4	3	4	3	3	4	4	3	4	3	3	3	3	3	3
9	3	3	3	3	3	3	3	3	4	3	4	3	3	3	4	5	8	6	4	3	3	4	4	4	4
10	4	5	8	5	4	4	5	5	4	4	4	4	4	4	4	4	3	3	4	4	4	4	4	4	4
11	4	4	4	5	5	6	5	4	10	8	4	4	4	3	3	3	3	4	4	4	4	4	4	5	5
12	6	6	4	5	12	12	14	13	10	8	6	5	5	4	4	4	3	4	7	6	5	4	4	4	6
13	5	4	4	4	4	4	5	10	11	9	7	7	5	4	4	5	5	4	4	4	4	4	4	4	5
14	4	4	4	4	4	4	5	4	4	5	6	4	5	5	4	4	4	6	5	5	4	5	6	5	
15	7	6	6	5	6	5	5	5	8	8	7	6	5	5	4	3	4	4	4	4	4	4	5	5	
16	6	6	4	4	4	4	4	4	4	4	4	3	4	4	3	3	3	4	4	4	4	4	4	4	
17	4	4	4	4	4	4	4	5	5	6	4	4	4	4	4	4	3	2	4	4	4	4	4	3	4
18	3	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	
19	4	4	4	4	4	4	4	4	4	4	4	4	4	3	3	3	3	4	4	4	3	3	3	4	
20	3	4	4	4	3	4	4	4	4	4	4	3	3	3	4	3	4	4	4	4	3	3	3	4	
21	7	4	4	6	5	4	4	4	4	4	4	4	4	4	4	4	4	3	3	4	4	4	4	4	
22	4	4	4	3	3	3	4	4	4	4	4	4	4	4	4	4	3	4	4	4	4	3	3	4	
23	3	3	3	3	3	4	3	3	4	4	4	4	3	3	3	4	3	3	3	4	3	3	3	3	
24	3	3	3	3	2	3	3	3	3	4	4	4	4	3	3	3	4	3	3	3	3	3	3	3	
25	3	3	3	3	3	3	3	3	3	4	4	4	4	3	3	3	3	3	3	3	3	3	3	3	
26	3	3	3	3	3	3	3	3	3	4	3	3	3	4	3	3	3	4	3	3	3	3	3	3	
27	3	3	3	3	3	4	3	4	4	4	4	3	3	3	4	3	3	3	3	3	3	3	3	3	
28	3	3	3	3	3	4	4	4	4	4	4	4	4	4	3	3	3	3	3	3	3	3	3	3	
29	3	3	3	3	3	3	3	3	5	3	3	4	4	4	5	5	5	4	4	4	5	5	4	4	
30	4	5	5	5	5	6	6	6	6	7	8	7	5	5	5	5	6	7	8	7	7	6	6	6	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES ABOVE LIMIT LEVEL		
MEAN	MEDIAN	MEAN	50	90	95	98	99	1-HR	-	14	3	24-HR	6	DEVIATION	VALID DATA	100	0		
4	4	4	4	6	7	9	10	2	-	14	3	-	6	1					

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : AP LEI CHAU
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	4	6	5	5	5	9	20	21	16	18	8	6	8	7	10	28	24	20	11	5	11	6	6	39	12
2	28	46	30	18	12	14	34	42	38	30	20	20	19	18	24	30	26	23	13	12	8	10	34	29	24
3	46	M	15	26	35	39	51	65	66	66	67	67	54	47	33	17	23	32	39	36	25	13	12	14	39
4	21	15	16	13	9	7	12	11	33	64	58	51	46	50	44	30	48	28	21	7	9	7	5	7	26
5	8	7	6	6	6	8	13	14	14	9	7	7	6	7	5	6	5	4	4	4	3	3	1	3	7
6	2	2	2	2	2	2	2	2	2	2	2	2	2	1	2	3	2	2	3	1	2	2	3	2	2
7	2	2	3	2	2	3	3	3	4	3	4	2	3	2	2	4	3	3	4	4	3	4	5	5	3
8	3	4	4	4	3	4	6	9	10	10	7	4	4	4	4	3	3	7	4	7	9	7	6	6	6
9	6	4	5	6	5	6	10	14	13	9	7	6	6	12	18	35	58	52	30	16	14	14	16	17	16
10	29	53	64	37	18	9	12	14	9	7	6	6	4	4	4	3	4	4	4	4	4	5	6	8	13
11	10	13	8	24	40	46	28	21	39	34	6	5	7	15	5	6	14	15	30	21	32	30	30	34	21
12	34	26	22	33	48	42	46	40	33	29	22	19	26	16	22	21	19	33	57	36	37	16	12	12	29
13	14	15	8	6	5	8	20	42	42	34	25	29	23	13	5	26	26	11	8	7	7	18	23	18	
14	14	8	8	8	16	29	12	12	20	16	6	4	7	10	17	19	21	57	44	42	36	50	42	37	22
15	59	51	39	26	37	33	35	29	49	51	52	39	22	34	20	26	18	20	26	23	19	30	34	66	35
16	64	57	8	6	7	8	11	14	12	9	13	10	9	16	16	9	10	12	7	8	13	12	6	5	14
17	6	M	4	4	6	9	12	19	26	26	13	10	7	6	6	4	4	2	6	7	7	6	7	10	9
18	9	10	4	5	5	6	5	5	5	6	6	5	4	4	4	3	3	5	4	3	4	6	4	5	
19	4	4	4	3	3	5	7	8	6	5	6	4	5	5	5	4	3	4	3	3	3	3	4	8	5
20	11	6	5	4	4	6	12	15	9	7	7	6	4	5	6	5	5	15	9	5	8	9	16	46	9
21	50	23	38	41	28	17	31	29	31	34	35	28	17	18	17	10	7	4	10	8	5	4	4	6	21
22	6	6	5	5	4	6	7	27	25	29	27	29	14	12	14	11	15	16	17	21	17	18	15	12	15
23	9	7	8	7	7	7	12	20	21	17	19	11	8	5	6	6	4	10	7	7	16	12	17	11	11
24	6	7	9	5	12	3	9	7	10	27	27	9	13	11	11	10	13	7	6	11	15	8	7	4	10
25	8	7	10	9	6	10	13	11	9	8	25	38	22	27	24	16	23	15	13	13	18	18	31	17	16
26	47	28	13	17	20	18	16	25	24	20	18	19	24	27	38	21	29	23	16	21	14	21	10	23	22
27	8	8	15	13	22	19	17	19	20	24	25	22	14	39	25	22	28	25	31	21	17	15	25	22	21
28	12	16	12	12	21	14	20	24	37	37	36	41	56	29	21	23	15	13	9	9	6	5	5	6	20
29	6	5	4	5	6	14	19	10	23	6	5	21	17	12	17	14	19	14	15	14	16	20	21	10	13
30	20	28	20	25	21	20	25	21	26	32	34	52	50	38	47	38	44	38	41	39	85	54	66	41	38

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEVIATION	VALID	DATA	ABOVE	LIMIT				0		
MEAN	MEAN	12	38	47	57	65	1	-	85	2	-	39	2	100					

- NOTES: 1. FLAGS FOR INVALID DATA :
- D: DYNAMIC CALIBRATION
 - T: TELEMETRY/DATALOGGER FAULT
 - M: MAINTENANCE OR ANALYZER FAULT
 - P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : CHEUNG CHAU
POLLUTANT : SULPHUR DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN	
1	7	5	4	4	4	5	5	6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4	2	
2	4	3	3	3	2	2	3	4	4	5	5	6	6	7	8	6	5	6	7	8	8	8	9	24	6	
3	16	14	14	14	14	15	15	16	15	14	15	1	0	1	1	1	1	2	1	4	4	5	5	16	9	
4	8	8	7	7	9	10	11	11	12	12	13	14	14	14	14	15	16	16	16	17	17	18	19	27	14	
5	2	1	1	1	0	1	1	2	4	6	6	7	8	9	8	10	11	11	12	12	13	13	14	24	7	
6	2	1	2	2	3	4	5	5	6	7	7	8	9	10	48	3	1	2	3	4	4	5	6	15	7	
7	10	10	10	11	12	13	13	14	15	16	16	17	17	18	19	19	20	20	21	22	22	23	23	24	18	
8	4	2	2	4	4	5	6	7	7	8	8	9	10	10	11	12	13	13	14	15	15	15	16	28	10	
9	1	0	1	2	2	2	3	3	4	5	5	5	6	7	8	8	9	10	10	10	11	11	11	12	22	7
10	11	11	12	12	13	13	14	15	16	17	1	0	3	1	3	5	6	8	8	10	11	12	13	23	10	
11	18	19	19	20	21	22	23	24	4	6	6	7	9	11	13	12	13	17	18	19	20	21	24	41	17	
12	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
13	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
14	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
15	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
16	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M	M		
17	M	M	M	M	M	M	M	M	M	M	M	M	M	M	11	11	11	11	11	11	11	11	11	11		
18	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11		
19	11	11	11	11	11	11	11	11	11	11	11	11	11	11	11	0	0	0	0	0	0	0	0	1	7	
20	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	8	0	
21	1	0	0	0	0	0	1	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	1	0	
22	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	
23	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	
24	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	
25	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	
26	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	
27	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	
28	1	0	0	1	1	1	0	0	1	1	1	0	0	0	0	1	0	0	0	0	0	0	0	2	0	
29	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	
30	1	1	0	0	0	0	0	1	6	3	2	3	2	1	1	1	1	2	1	1	2	1	1	4	1	

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE			STN	GEOM	DEVIATION	VALID DATA	NO. OF TIMES			
		50	90	95	98	99	1-HR	24-HR	82	1	-	48	0	18	3	82	0	1	2	3
MEAN	MEAN	5	1	15	19	23	24	0	-	48	0	-	18	3	82	0	0	1	2	3

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

THE HONGKONG ELECTRIC COMPANY, LTD.
AIR QUALITY DATA MONTHLY TIME SERIES REPORT
MONTH: SEPTEMBER

STATION : CHEUNG CHAU
POLLUTANT : NITROGEN DIOXIDE

YEAR : 2024
UNIT : MICROGRAMS/CUBIC METER

DAY	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	MEAN
1	41	31	27	30	36	34	32	27	20	19	16	5	5	8	4	7	5	6	6	9	36	22	29	31	20
2	26	18	11	8	22	32	44	37	13	11	16	15	12	11	13	14	16	17	19	11	9	12	51	16	19
3	60	30	42	55	56	65	64	68	56	55	47	36	29	27	19	30	38	24	31	34	30	23	13	21	40
4	36	65	64	67	71	89	80	69	59	50	49	33	41	39	36	38	22	38	38	14	11	11	12	15	44
5	51	36	68	48	15	23	43	33	32	34	28	26	21	26	26	18	12	5	6	5	4	3	5	5	24
6	8	6	10	10	4	2	11	9	9	8	12	8	5	3	4	6	4	1	3	4	3	3	3	3	6
7	4	7	8	9	10	10	13	10	8	8	8	8	7	11	9	16	11	12	13	10	7	9	6	9	
8	10	18	18	23	17	21	8	10	12	23	18	8	6	5	4	7	7	6	9	8	5	9	10	6	11
9	11	9	8	16	33	26	9	29	37	34	13	5	5	10	12	5	19	36	13	27	40	13	10	15	18
10	37	52	42	51	57	61	19	28	34	31	23	21	10	6	6	6	10	14	10	13	14	11	19	15	25
11	28	M	43	52	39	37	50	52	43	39	22	13	10	8	8	10	5	6	11	16	10	14	6	21	24
12	22	35	40	26	19	22	14	15	16	27	17	12	7	5	5	6	16	10	8	8	9	24	37	36	18
13	22	17	13	13	15	27	51	30	15	13	14	11	6	5	6	8	6	12	11	15	27	12	18	39	17
14	25	28	25	36	50	33	42	48	48	28	26	8	4	7	5	6	12	45	40	80	66	46	72	44	34
15	42	64	80	83	72	68	53	44	41	42	16	16	18	15	14	12	15	21	24	13	15	24	20	19	35
16	57	67	45	21	33	36	44	41	39	56	41	29	24	27	21	26	18	13	9	9	11	26	15	18	30
17	25	23	17	17	25	33	35	31	28	33	45	35	M	M	M	M	M	5	9	18	27	9	9	6	23
18	18	17	25	27	25	13	7	6	7	8	8	4	3	6	5	8	6	5	9	10	16	10	10	11	
19	6	11	6	5	4	5	11	11	7	12	12	12	6	8	6	3	3	4	5	5	4	5	5	7	
20	6	9	28	44	35	46	52	54	44	31	23	15	5	7	7	12	18	10	6	8	10	36	40	55	25
21	31	21	69	63	56	61	35	20	31	45	19	22	39	20	22	13	12	10	9	16	9	7	6	7	27
22	9	12	11	8	29	21	19	24	33	28	27	25	31	41	22	17	23	38	37	32	19	16	15	14	23
23	13	9	10	9	11	16	18	24	29	27	33	34	37	19	9	6	6	4	3	5	9	22	40	9	17
24	5	3	11	8	8	5	3	4	5	9	9	12	17	7	18	2	2	4	4	5	6	4	6	5	7
25	6	M	6	7	5	6	8	10	5	31	23	16	5	6	5	4	5	6	6	8	6	8	16	9	
26	14	14	9	10	7	10	10	14	11	7	6	9	9	5	6	6	7	10	10	9	6	7	7	9	
27	5	7	6	6	7	9	12	10	12	21	11	9	6	7	10	10	12	12	8	7	7	6	10	7	9
28	8	9	12	10	22	37	20	26	38	30	62	26	15	13	12	25	12	18	11	8	6	6	3	7	18
29	5	6	5	5	6	7	21	43	27	21	12	7	3	5	5	5	5	4	5	6	5	4	4	14	10
30	12	12	7	12	18	8	16	27	46	59	46	66	60	32	28	27	26	53	54	56	98	48	54	78	39

MONTHLY STATISTICS:

GEOM	ARITH	PERCENTILES								RANGE				STN	GEOM	PERCENT	NO. OF TIMES		
		50	90	95	98	99	1-HR	24-HR	DEVIATION	VALID	DATA	ABOVE	LIMIT				0	0	0
MEAN	MEDIAN	MEAN	50	90	95	98	99	1	-	98	6	-	44	2	99				

NOTES: 1. FLAGS FOR INVALID DATA :

- D: DYNAMIC CALIBRATION
- T: TELEMETRY/DATALOGGER FAULT
- M: MAINTENANCE OR ANALYZER FAULT
- P: POWER FAILURE

Appendix C Summary Results on Water Quality Monitoring

LAMMA POWER STATION FGD WASTEWATER TREATMENT PLANT EFFLUENT DISCHARGE TO ASH LAGOON SUSPENDED SOLIDS AND pH

Period : July - September 2024

Week Ending	No. of Samples	Suspended Solids, mg/L			pH		
		Maximum	Minimum	Average	Maximum	Minimum	Average
06/07/24	3*	15	7	11	8.4	8.3	8.4
13/07/24	4*	12	7	9	8.3	8.2	8.3
20/07/24	1*	11	11	11	8.2	8.2	8.2
27/07/24	5*	9	6	7	8.2	8.1	8.1
03/08/24	5*	12	8	10	8.3	8.2	8.3
10/08/24	2*	10	10	10	8.6	8.6	8.6
17/08/24	5*	10	7	9	8.4	8.1	8.2
24/08/24	1*	8	8	8	8.1	8.1	8.1
31/08/24	5*	12	6	8	8.2	8.0	8.1
07/09/24	3*	8	5	7	8.2	8.0	8.1
14/09/24	2*	15	6	11	8.0	7.8	7.9
21/09/24	0*	N/A	N/A	N/A	N/A	N/A	N/A
28/09/24	3*	12	8	10	8.5	8.1	8.3

Remark :

* - No sampling for the remaining day(s) of the week / no sampling due to no discharge

LAMMA POWER STATION
FGD WASTEWATER TREATMENT PLANT
EFFLUENT DISCHARGE TO ASH LAGOON
TRACE METAL, TOTAL PHOSPHORUS
AND TOTAL NITROGEN ANALYSIS

Period : July – September 2024

Sampling date	3/7/2024	7/8/2024	4/9/2024
Barium, ug/L	<150	<150	<150
Mercury, ug/L	<0.5	<0.5	<0.5
Cadmium, ug/L	1.7	2.8	<1.0
Iron, ug/L	<400	<400	<400
Total Phosphorous, mg/L	<0.8	<0.8	<0.8
Total Nitrogen, mg/L	115	82	41
Cyanide, mg/L	0.01	<0.01	<0.01

Remark:

According to the WPCO Ash Lagoon Discharge Licence, contents at exact levels of trace metals below 1/10th of the WPCO Licence permitted limits will not be reported. When the concentration of a metal exceeds 1/10th of the limit, the exact value of the metal concentration will be reported.

Appendix D Summary of EMIS

EM&A Log Ref.	Mitigation Measures	Implementation Status
	GENERAL	
A1	No other process, except the Wet Limestone-Gypsum process used in the FGD plants of the coal-fired Units L6, L7 and L8 within the Lamma Power Station, shall be used in the FGD plants for the projects unless otherwise agreed by EPD.	Complied
	WATER QUALITY	
B1	All wastewater arising from the operation of the projects shall be collected and directed to the existing wastewater treatment plant within the Lamma Power Station for treatment.	Complied
B2	The operational plant effluent from the FGD plants should be reused as much as possible in order to minimise discharge to the WWTP.	Complied
B3	Maintenance of the WWTP should be performed regularly to ensure the effluent from the WWTP would not exceed the current requirements stipulated in the WPCO licence for Ash Lagoon.	Complied
	WASTE	
C1	No gypsum or sludge arising from the operation of the projects shall be disposed of anywhere. All gypsum and sludge shall be collected and reused.	Complied
	NOISE	
D1	Equipment including the Absorber Recirculation Pump, Oxidation Air Blower, Booster Fan and Booster Fan Motor of the FGD plants shall be acoustically insulated and the Gas-Gas Heater (untreated side) of the FGD plants shall be provided with reinforced lagging to reduce the noise impact.	Complied