


\* Process flow diagram provided below is subject to detailed design to be carried out by the future DBO contractor.

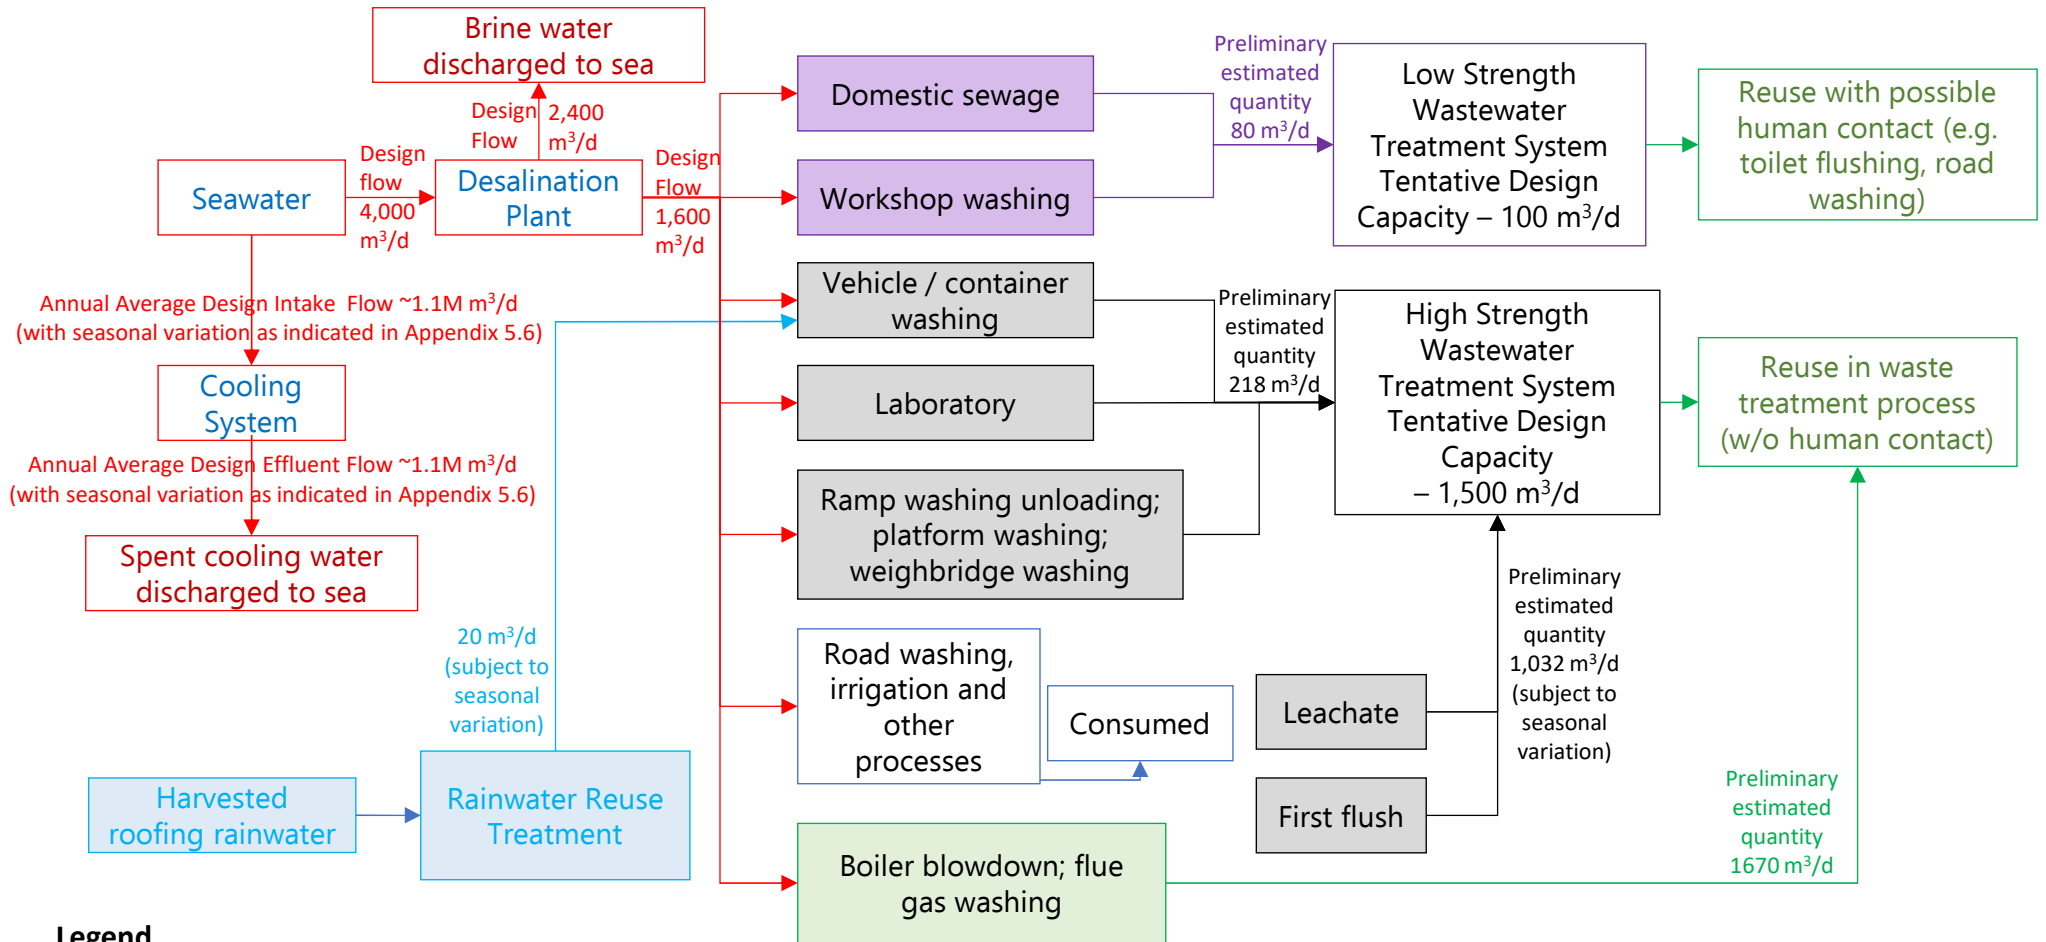


**Legend**

- Type 1 wastewater will be tertiary treated and reuse on-site (without human contact)
- Type 2 wastewater will be tertiary treated to meet the WSD’s Water Quality Standards for Treated Grey Water and Rainwater Effluent for reuse on-site (with human contact)
- Type 3 wastewater will be directly reused on-site (without human contact)

**Process Flow Diagram for Wastewater Treatment Management (Option 1)**

\* Process flow diagram provided below is subject to detailed design to be carried out by the future DBO contractor.

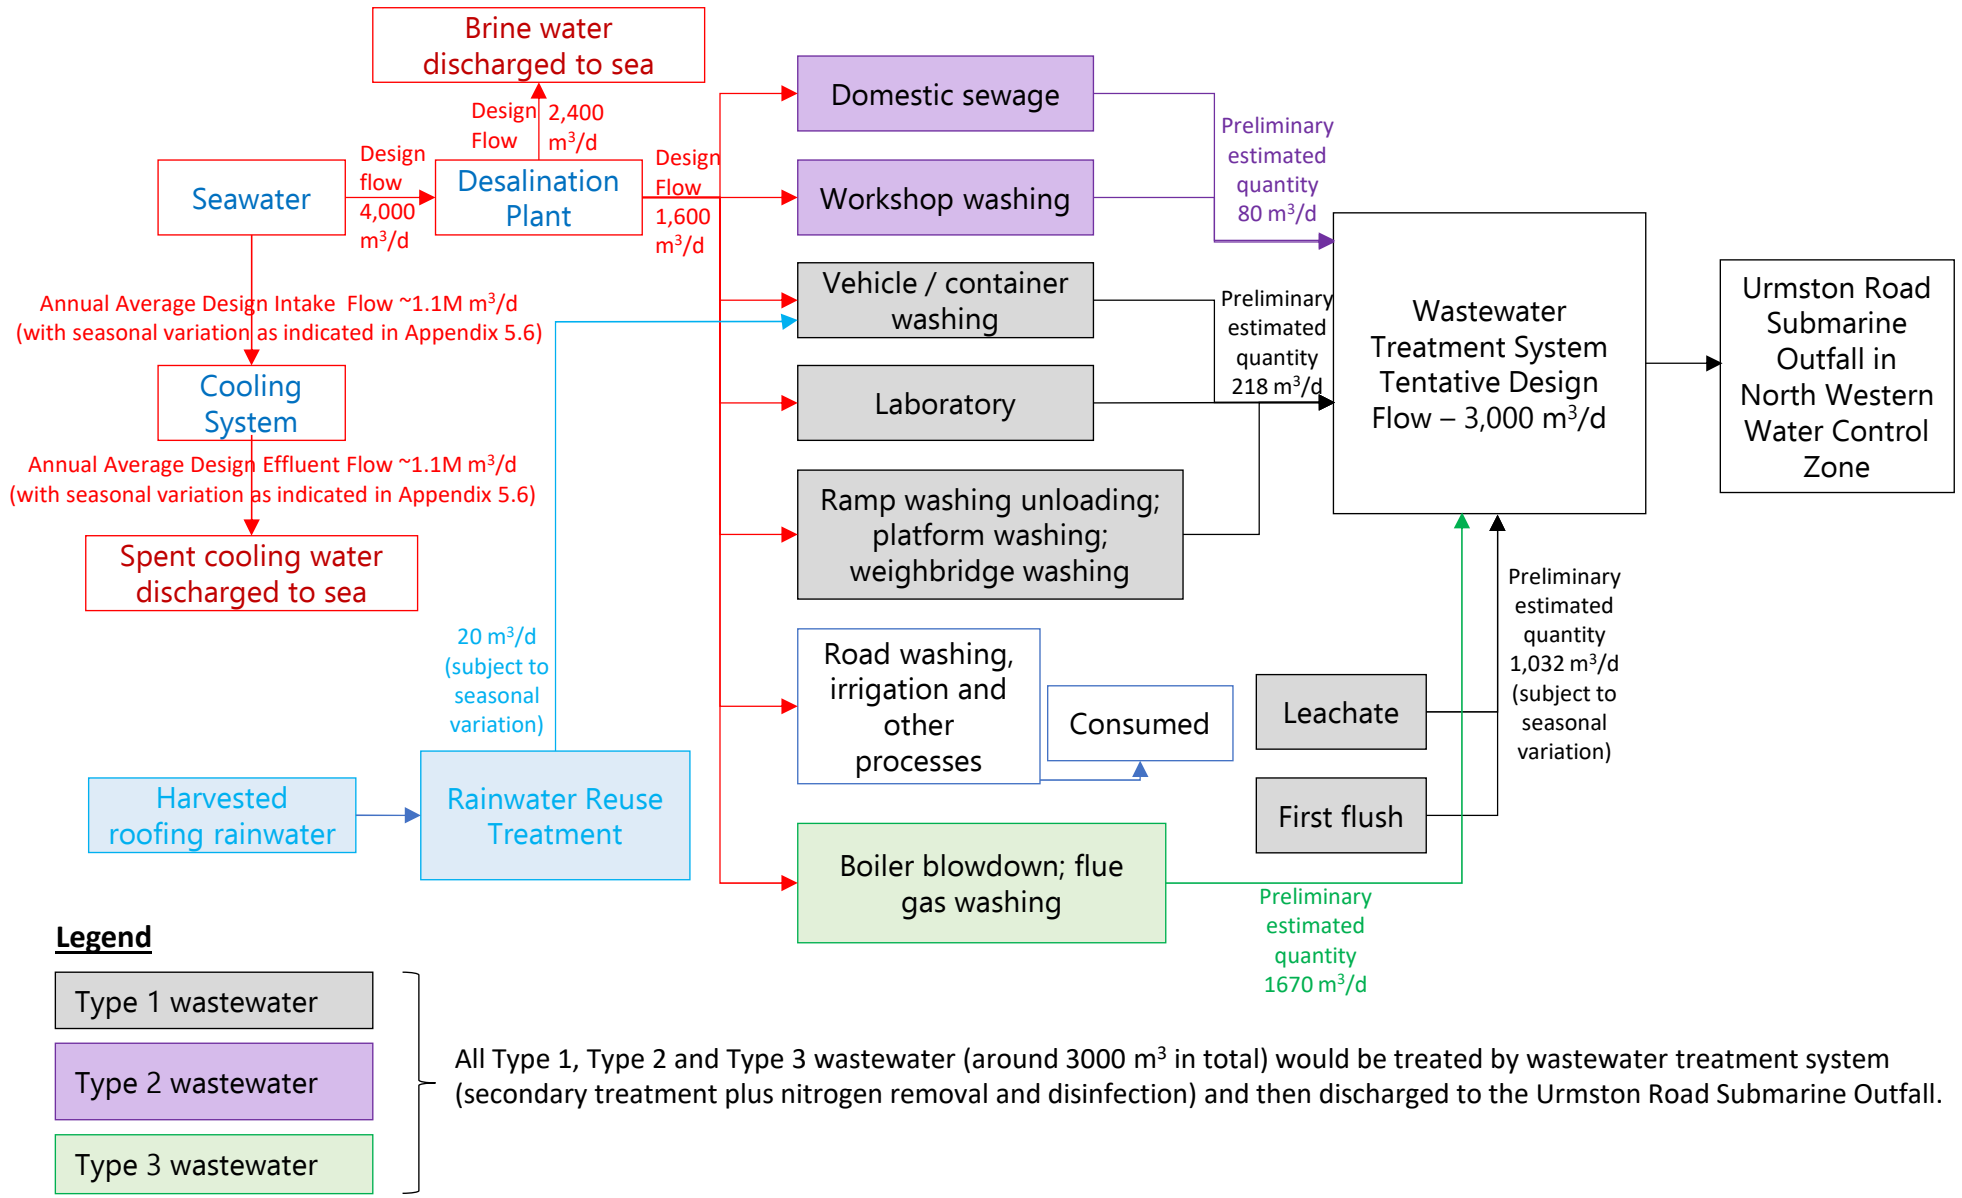

## Process Flow Diagram for Wastewater Treatment Management (Option 2)